ISSUED November 1, 1990 SHEET NO.

Technical Data

GSV Screw Compressor Description

Description

The ten models of the Gram GSV Rotary Screw Compressor units described herein range in capacity from 504 m³/h to 5620 m³/h at 2950 rpm. Standard units are designed for use on ammonia, halocarbon and hydrocarbon refrigerants at pressure ratios up to 26:1.

GSV Rotary Screw Compressor Units consist of the following major components: - Rotary Screw Compressor, oil pump and filter; drive coupling and guard; combined stop and check valve and filter on suction side. Combined stop and check valve on the discharge side; suction scale trap with strainer, and a three stage horizontal oil separator/reservoir. All components have been selected for maximum reliability and arranged to assure accessibility for service. The units are factory packaged, complete with wiring and piping.

Model GSV Compressor

Housing - All screw compressor castings are designed and tested to meet the requirements of common standard for 25.0 bar maximum discharge pressure. Castings are close grain ASTM-A 278 Class 40 cast iron to assure structural integrity, mechanical and thermal stability under all operating conditions.

Rotors - The rotors are machined from AISI-1137 steel forgings to the exacting tolerances of the latest SRM asymmetric profile. The four lobed male rotor is directly connected to the driver. The six lobed female rotor is driven by the male rotor on a thin oil film.

Bearings - Antifriction bearings are used for reduced power consumption, particularly at the higher pressure ratios. Cylindrical roller bearings are provided to handle the radial loads and the thrust loads are absorbed by angular contact ball bearings. In addition, thrust balance pistons are provided to reduce the thrust load and improve bearing life.

Shaft Seal - The compressor shaft seal is a metal bellow seal with a carbon rotating surface riding against a cast iron stationary seat. The seat is capable of sealing in proscribed pressure area.

Variable Volume Ratio Control - The Gram compressor includes a patented method of varying the internal volume ratio to match the system pressure ratio. With control of the internal volume ratio the power penalty associated with over or under compression is eliminated. The volume ratio control is achieved by the use of a slide stop which is a movable portion of the rotor housing that moves axially with the rotors to control the discharge port location. The slide stop is moved by hydraulic actuation of a control piston based on signals from the micro processor. The range of adjustability is from 2.2 Vi to 5.0 Vi.

Capacity Control - Capacity control is achieved by use of a movable slide valve. The slide valve moves axially with the rotors to provide fully modulating capacity control from 100% to approximately 10% of full load capacity. The slide valve is positioned automatically by hydraulic movement of its control piston based on time proportioned signals from the micro processor. When in the unloaded position, gas is by-passed back to suction through a recirculation slit before compression begins and any work is expended.

Lubrication System - The GSV compressor is designed specifically for operation without an oil pump. All oil required for main oil injection and lubrication is provided by positive gas differential pressure.

The standard high stage unit is furnished with a close- coupled positive displacement prelube pump for start-up only. For some low pressure differential applications full time or cycling lube pump will be required.



ISSUED April 1, 1991

SHEET NO. 2 40 02

Technical Data

GSV Screw Compressor Description

Oil Separator/Reservoir - The oil separator is a horizontal, three stage design with integral sump. Two sight glasses are located in the reservoir section and one in the coalescing section. The separator is designed and constructed in accordance with common standards for a maximum design working pressure of 25.0 bar and supplied with by-pass valve from discharge to suction. Two heaters maintain oil temperature higher than surrounding during compressor shut-down.

Coalescent separator elements are provided for final gas/oil separation of particles down to less than 1 micron. The oil carry over to the refrigeration plant will normally be less than 10 PPM.

Oil is drained from the coalescer section and returned to the compressor suction during operation.

A float switch is installed in the first stage of the oil separator to detect a low oil level. If a low level occurs the float switch will shut the compressor down.

Oil Filter - All lubrication oil will pass through a $25\mu m$ absolute oil filter ($\beta_{25} \ge 75$ ISO 4572). Solid containcenants will be kept down to code 20/16 after ISO 4406. The filter is furnished with isolation stop valves and drain valve for ease of servicing.

Technical Data


GSV Screw Compressor Description


Liquid Injection Oil Cooling - The compressor, oil is cooled by direct contact with refrigerant injected through one of two optimized port locations prior to the compressor discharge. Liquid feed arrangement includes a stop valve, strainer, solenoid valve, metering valve and stop valve. The metering valve will maintain temperature of oil returning to the compressor between 50°C and 70°C. At booster application liquid will be injected into the compressor after the compression has come to an end. This will not affect the capacity.

Water Cooled Oil Cooling - The optional water cooled oil cooler is a shell and tube design with oil on the shell side. The oil temperature is maintained at 50°C - 60°C. As optional an automatically water regulating valve sensing outlet oil temperature can bee supplied.

Thermosyphon Oil Cooling - Maintains oil temperature 10°C - 20°C higher than condensing temperature. The optional thermosyphon cooler is a shell and tube design. The oil cooler is mounted on the unit with the oil piping connected. Refrigerant connections and controls are field installed.

Economizer - Increased refrigeration capacity with relatively low increase in brake horsepower can be achieved by the use of a Gram economizer system. The economizer consists of a shell and coil or shell and tube liquid subcooler with appropriate controls. Refrigerant vapor from the subcooler is piped to an optimized pressure port on the compressor.

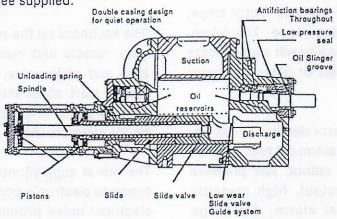

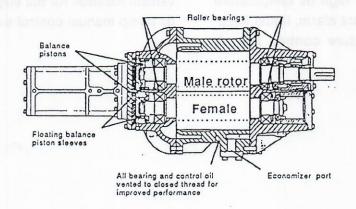



ISSUED November 1, 1990

SHEET NO. 2 40 04

Technical Data

GSV Screw Compressor Description

Microprocessor Control Center

The compressor control system is factory mounted, completely piped and wired with all the required safety and operating devices. The control system includes as standard microprocessor control panel and a separate power/supply junction box. All transducers are wired and piped into a common manifold with a rated housing.

The microprocessor panel is supplied with a display. Continuous display may indicate: suction pressure and temperature, discharge pressure and temperature, oil pressure and temperature, filter pressure drop, slide valve position and mode, volume ratio position and mode, pump on/off, percent of full load motor amps, and compressor operating mode. The microprocessor continuous display will also indicate that alarm condition exists or other messages as required.

Through the microprocessor display, by call up, the following control and alarm set points will be indicated: low pressure cutout, low pressure alarm, high pressure cutout, high pressure alarm, filter differential alarm, discharge temperature cutout, discharge temperature alarm, oil pressure cutout, oil pressure alarm, suction pressure control, high oil temperature cutout, high oil temperature alarm, liquid injection oil cooling temperature control, low oil

temperature cutout, low oil temperature alarm, oil heater temperature control, low oil level and motor load control.

The microprocessor panel provides annuciation to indicate the first cause of shutdown as well as prealarms to warn of potential shutdown conditions. The panel will also store the exact operation conditions at the time of any shutdown or trip, and these data may be recalled via the "freeze display".

Included in the microprocessor is time proportioning capacity control. This method of capacity control reduces hunting and provides a more stable capacity control.

The keyboard on the microprocessor includes: auto, remote and manual control of the slide stop and slide valve, compressor run, stop, remote start, alarm silence and display control. An emergency stop button is clearly mounted on the microprocessor panel.

The power supply/junction box is furnished to separate electronic components from heat and electrical noise producing components. This junction box supplies a single terminal point for customer wiring to the package and a convenient location for the elapsed time meter and oil pump manual control switch.

ISSUED January 1, 1995 SHEET NO. 2 40 11

Technical Data

GSV/GSB Screw Compressor Design Limitations

Compressor type:	GSV	GSV	GSV/B	GSV/B	GSV/B	GSV/B
412 562	50	64	84	111	147	185
Rotor diameter [mm]	163.2	163.2	193	193	233	233
Length/diameter ratio	1.35	1.70	1.35	1.80	1.35	1.70
Theoretical displacement per drive	.0028511	.0035903	.0047155	.0062873	.0082971	.010448
shaft revolution [m³/rev. (ft³/rev)]	(.100684)	(.126788)	(.166523)	(.222029)	(.293003)	(.368960)
Normal 50 Hz motor speed [rpm]	2950	2950	2950	2950	2950	2950
Displacement at above speed	504.6	635.5	834.6	1112.9	1468.6	1849.3
[m³/h (ft³/min)]	(297.0)	(374.0)	(491.2)	(655.0)	(864.4)	(1088.5)
Special 60 Hz motor speed [rpm]	3550	3550	3550	3550	3550	3550
Displacement at above speed	607.3	764.8	1004.3	1339.3	1767.3	2225.4
n³/h (ft³/min)]	(357.2)	(449.9)	(590.8)	(669.3)	(1039.6)	(1309.1)
Max. Motor torque at start up. [Nm]	2600	2600	6000	6000	9000	9000
Max. power continuously at 50 Hz [kw]	160	160	315	315	.500	500
Min./max. motor speed [rpm]	1800 / 4500		LEE HER			
Drive arrangement	Direct drive,	coupling only	03-5/10/5/5/1			
Volume ratio	GSB: Vi = 2.		ariable from 2.	.2 to 5.0		
Capacity control		s: 100%, 75% 100% to 10%		ull load inite adjustme	ent	spacity con
Rotation of drive shaft		cing the shaft			Hills e.	
Maximum outlet pressure	pe = 25.0 b	ar (363 psig)			STUBERT GOT	
Operating pressure limits	See data sh	eet 0.70.42	Deans Blab at			
Maximum differential pressure	Discharge p	ressure - suc	tion pressure	= max. 24.0 b	par (348 psi)	
Minimum inlet temperature *	-60°C (-76°	°F)				
Maximum inlet temperature	93°C (199°F	•)				
Maximum temperature differential	Discharge te	emperature -	suction tempe	rature = max.	135°C (275	°F)
Maximum outlet temperature	120°C (248°	F)	Translati			
Maximum oil supply temp. **	80°C (176°F		THE RELIES			
inimum oil viscosity ***	Kinematic 1	0 cst	Dun Zantanun			
Minimum oil pressure	-oil pressur -oil pressur The delay ti Additionally, is (closed th	e is more than me on cut-out if there is a s read pressure	the discharge closed thread is set to 3 min plenoid valve + 1 bar). De	e pressure -1 d pressure + 3 nutes. in the oil line, lay time 20 se . Delay time 2	the minimum	oil pressure
Maximum oil pressure		e discharge p				
Max. Shaft load, axial and radial	200 N					
Oil filtration	According to	ISO 4572, B	25 >75 and B	10 >7		
Solid contamination in oil		ISO 4406 C		A STATE OF THE STA		The same of

Minimum suction pressure can be lower, but the sensitive temperature to the compressor should meet the above specification. Minimum inlet pressure is 0.4 bar for high stage compressors.

If the unit is equipped with stop valve on suction side, the suction pressure has to be measured between the stop valve and the compresssor.

Recommended oil from sheet 2.00.41/42 has only required viscosity when oil temperature is kept below 65°C.

Remember that oil viscosity will be reduced as refrigerant dissolves into the oil.

') Use level switch or flowmeter to ensure that the oil pressure transmitter/switch measures oil and not gas.

ISSUED January 1, 1995 SHEET NO. 2 40 12

Technical Data

GSV/GSB Screw Compressor Design Limitations

Compressor type: *	GSV/B	GSV/B	000	001/	
-	263	The second second	GSB	GSV	GSV
Rotor diameter [mm]		331	465	412	562
Length/diameter ratio	283.	283	. 283	355	355
Theoretical displacement per drive	1,35	1,70	2,40	1,10	1,50
shaft revolution [m³/rev. (ft³/rev)]	.0148670	.0187210	.0264296	.0232900	.0317590
Normal 50 Hz motor speed [rpm]	(.525013)	(.661113)	(.933335)	(.822462)	(1.121536)
Displacement at above speed	2950	2950	· 2950	2950	2950
[m³/h (ft³/min)]	2631.5	3313.6	4678.0	4122.3	5621.3
Special 60 Hz motor speed [rpm]	(1548.8)	(1950.3)	(2753.4)	(2426.3)	(3308.6)
Displacement at above speed	3550	3550	3550	3550	3550
[m³/h (ft³/min)]	3166.7	3987.6	5629.6	4960.7	6764.6
Max. motor torque at start up. [Nm]	(1862.8)	(2345.6)	(3311.5)	(2918.1)	(3979.2)
Max. power continuously at 50 Hz	17000	17000	17000	26000	26000
[kW]	1000	1000	1000	1600	1600
Min./max. motor speed [rpm]	1800/3600				
Drive arrangement	Direct drive, cou	pling only.			
Volume ratio	GSB: Fixed Vi =		/ariable from 2.2	to 5.0	
Capacity control	GSB: 3 steps: 10	00%, 75% and 5	0% of full load		
Rotation of drive shaft	GSV: From 1009	% to 10% of full I	oad infinite adju	stment	
	Clockwise facing				
Maximum outlet pressure Operating pressure limits	pe = 25.0 bar (36				
Maximum differential pressure	See data sheet 0				
Minimum inlet temperature **	Discharge press	ure - suction pre	essure = max. 2	4.0 bar (348 psi)
	-60°C (-76°F)				
Maximum inlet temperature	93°C (199°F)				
Maximum temperature differential	Discharge tempe	erature - suction	temperature = r	max. 135°C (27	5°F)
Maximum outlet temperature	120°C (248°F)		•		
Maximum oil supply temperature ***	80°C (176°F)				
Minimum oil viscosity ****	Kinematics 10 cs	And the second s			
Minimum oil pressure	The minimum red	quirement is:			
****	-oil pressure is n	nore than the dis	charge pressure	e -1,5 bar. and	
	-oil pressure is n	nore than closed	thread pressure	e + 3 bar.	
	The delay time o	n cut-out is set	to 3 minutes.	3	
	Additionally, if the	ere is a solenoid	valve in the oil li	ne, the minimun	n oil pressure
	is(closed thread p	pressure + 1 bar). Delay time 20	sec	•
In the second second	Alternatively you	can use a flow s	witch. Delay tim	e 20 sec. too.	
Maximum oil pressure	3,4 bar above dis	charge pressure)		
Max. Shaft load, axial and radial	200 N				
Oil filtration	According to ISO				
Solid contamination in oil	According to ISO	4406 Code 20/1	6		

^{*)} GSV 412 and 562 require special oil pressure regulating arrangement for oil pressure to the balance piston. Contact Gram Refrigeration

If the unit is equipped with stop valve on suction side, the suction pressure has to be measured between the stop valve and the compressor.

Recommended oil from sheet 2.00.41/42 has only required viscosity when the oil temperature is kept below 65°C.

Remember that oil viscosity will be reduced as refrigerant dissolves into the oil.

^{**)} Minimum suction pressure can be lower, but the sensitive gas temperature to the compressor should meet the above specification. Minimum inlet pressure 0.4 bar for high stage compressors.


ISSUED January 1, 1995 SHEET NO. 2 40 13

Technical Data

GSV/GSB Screw Compressor

Operating Pressure Limits


Curves below show the operating pressure limits for speed at 2950 rpm. Do not use GSB at pressure ratios above 10 or discharge pressure above 15°C. Always use oil pump on GSB.

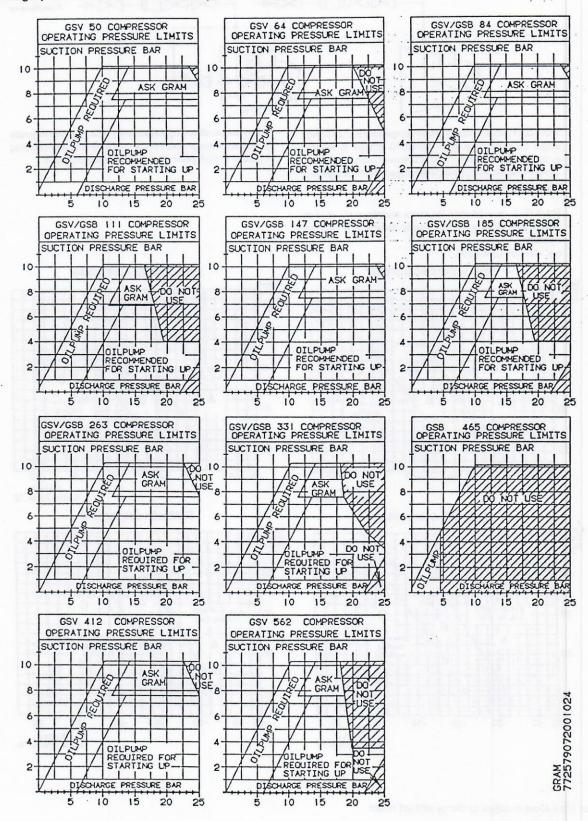

ISSUED March 1, 1992 SHEET NO. 2 40 15

Technical Data

GSV/GSB Screw Compressor Liquid Injection - Limitations

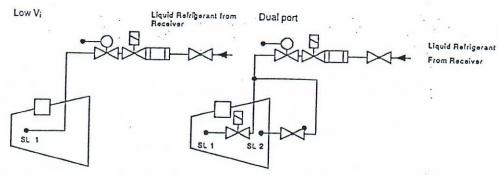



Port SL1 is used when the screw compressor is used as high stage compressor at e.g. -10/+35°C (range B without economizer). NB at e.g. -10/+35°C with economizer it is not allowed to use liquid injection. Use refrigerant thermosyphon or water cooled oil cooler.

When hot gas defrosting is used during which the pressure ratio is reduced, these pressure ratios should be used when chosing injection. In such cases an oil cooler is recommended.


Port SL2 is used when the screw compressor is used as booster compressor or when the compressor is, with dual port injection.

e.g. -40/+35°C. (range A).







R-22 without economizer



NH3 with economizer



R-22 with economizer




AGram Refrigeration°

ISSUED March 1, 1992 SHEET NO. 2 40 21

Technical Data

GSV 50-111 Screw Compressor Block Dimensions

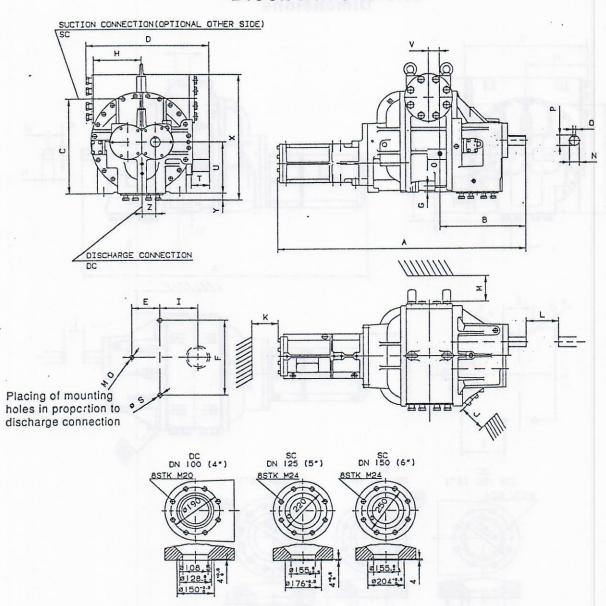

	Α	В	С	D	E	F	G	Н	1	J	K	L	M	N
GSV 50	1168	403	460	615	123	380	34	230	189	98	525	75	410	42
GSV 64	1226	403	480	652	180	380	34	265	189	98	623	75	482	42
GSV 84	1388	478	535	676	155	420	35	265	208	132	621	100	482	55
GSV 111	1478	478	550	678	242	420	35	265	208	132	764	100	482	55

(8) (8)	0	Р	Q	S	T	U	٧	X	Y	Z	SC*	DC*
GSV 50	12	45	M24	Ø25	102	260	47	614	36	64	DN 100 (4")	DN 80 (3")
GSV 64	12	45	M24	Ø25	102	260	76	651	36	64	DN 125 (5")	DN 80 (3")
GSV 84	16	59	M24	Ø25	102	290	63	708	38	76	DN 125 (5")	DN 100 (4")
GSV 111	16	59	M24	Ø25	102	290	106	738	38	76	DN 150 (6")	DN 100 (4")


All information given above is subject to change without notice

* DIN 2635/2512 ISO 7005

ISSUED December 1, 1990 SHEET NO. 2 40 22

Technical Data

GSV 147 - 185 Screw Compressor Block.
Dimensions

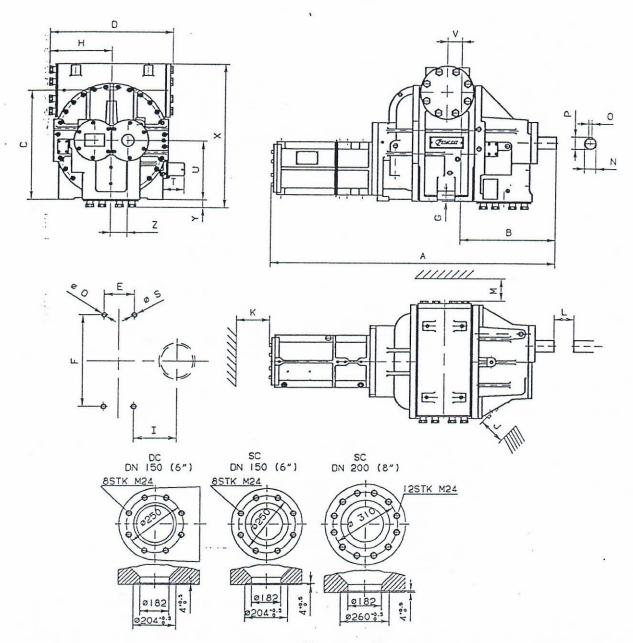


	Α	В	C	D	E	F	G	Н	ı	J	K	L	M	N
GSV 147	1600	533	606	684	165	510	35	343	243	132	760	110	554	63.5
GSV 185	1682	533	647	684	247	510	35	343	243	132	76 0	110	554	63.5

		0	P	Q	S	T	U	V	X	Y	Z	SC *	DC *
GSV 1	147	18	67.5	ø25	ø25	119	327	82.5	799.0	43	41.4	DN 150 (6")	DN 150 (6")
GSV 1	185	18	67.5	ø25	ø25	119	327	123.3	877.5	43	91.4	DN 200 (8")	DN 150 (6")

* DIN 2635/2512 ISO 7005

Technical Data

GSV 84 - 111 - 147 - 185 Screw Compressor Block.
Port Description

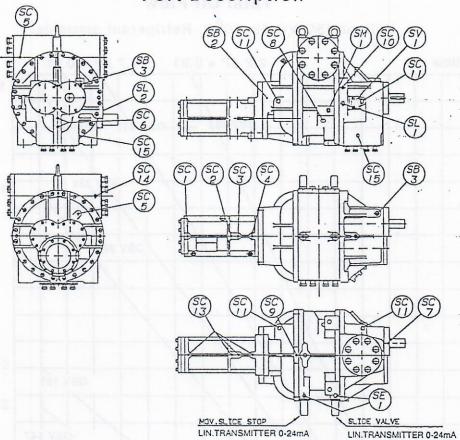

Symbol		Port Description	Size
SC 1	Slidevalve-unload		Rc 1/4*
SC 2	Slidevalve-load		Rc 1/4"
SC 3	Moveable slide stop-increase Vt		Rc 1/4"
SC 4	Moveable slide stop-decrease Vt		Rc 1/4"
SC 5	Inlet pressure		Rc 1/4"
SC 6	Discharge pressure		Rc 1/4*
SC 7	Seal weepage		Rc 1/4*
SC 8	Oildrain connection	. (Closed Thread)	Rc 1*
SC 9	Inlet oildrain		Rc 1/4*
SC 10	Discharge bearings prelube	(Optional)	Rc 3/4"
SC 11	Oildrain connection	(Optional)	Rc 3/4"
SC 13	Oildrain cylinder		Rc 1/4*
SC 14	Oilfill valve		Rc 1/2*
SC 15	Outlet pressure	(For sensor bulb or Pt-100)	Rc 1/2*
SB 2	Inlet bearing blance piston		Rc 1/4*
SB 3	Discharge bearings-seal		Rc 3/4*
SE 1	Electrical connector		Rc 1/2*
SM 1	Main oil injection		Rc 3/4"
SV 1	Vapor injection tongue-groove *		ø38
SL 1	Low Vi liquid injection		Rc 3/4"
SL 2	High Vi liquid injection		Rc 3/4*

^{*} With economizer connection use Danfoss flange No. 027N2340 Gram art. No. 61-021-0011.

ISSUED July 1, 1992


SHEET NO. 2 40 33

Technical Data

GSV

Screw Compressor Total Oil Flow

With oil ISO VG 68, 50°C. Refrigerant ammonia.

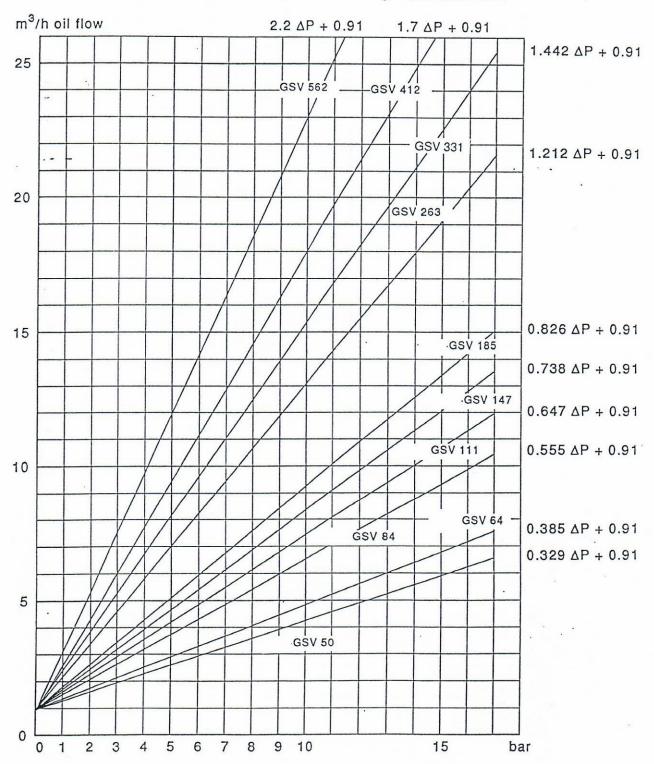

ΔP: Oil pressure minus suction pressure (Poil - Ps) bar.


ISSUED July 1, 1992 SHEET NO. 2 40 34

Technical Data

Screw Compressor GSV/GSB Bearing Oil Flow (Port SB2 and SB3) With Oil ISO VG 68, 50°C. Refrigerant ammonia.

GSV/GSB	Oil flow m ³ /h
50 - 64	0.176 ΔP + 0.45
84 - 111	0.220 AP + 0.45
147 - 185	0.264 AP + 0.45
263 - 331 - 465	0.329 ΔΡ + 0.45
412 - 562	0.365 ΔP + 0.45

GSV/GSB 412 - 562

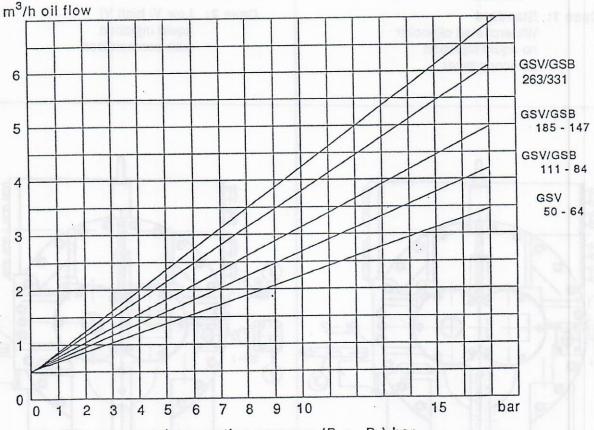


 ΔP : Oil pressure minus suction pressure (P_{oil} - P_{s}) bar.

ISSUED October 1, 1991

SHEET NO. 2 40 35

Technical Data

GSV 50-185 Screw Compressor Block. Optional Connections

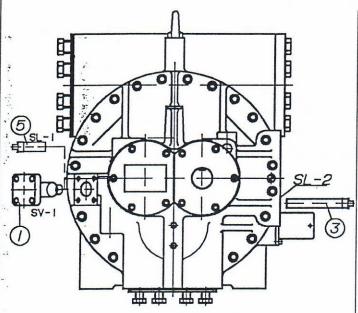


Case 1: Standard


Watercooled oilcooler

no liquid injection


no economizer

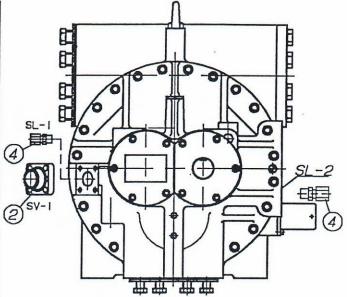

Case 2: Low Vi high Vi liquid injection with ecomomizer

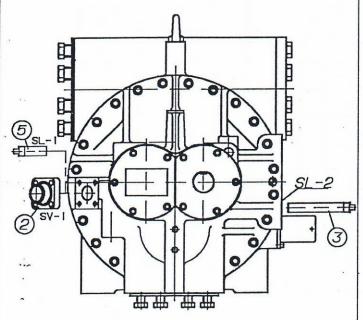


Case 3: Watercooled oilcooler no liquid injection with economizer

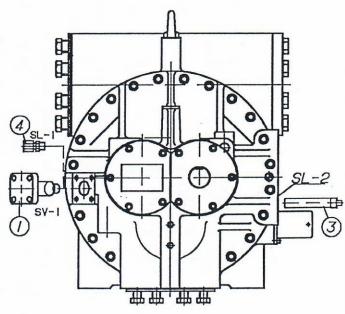


Case 4: Low Vi liquid injection only

Technical Data


GSV 50-185 Screw Compressor Block. Optional Connections



Case 5: Low Vi and high Vi Liqud injection no economizer



Case 6: Low Vi liquid injection with economizer



Case 7: High Vi liquid injection no economizer

Port description

SV-1	Economizer
SL-1	Low Vi liquid injection
SL-2	High Vi liquid injection


Item	had to signed to	1.212(30)	GSV	Gram nr.
1		Economizer plug	50-64 84-111 147-185	77-163-2040 77-193-2040 77-193-2040
2	(2)	Economizer flange (welding connection ø48,3)	50-64 84-111 147-185	61-021-0011
3	€=-	High Vi plug (Rc 3/4*)	50-64 84-111 147-185	77-163-2044 77-193-2044 77-233-2044
4	-	Pipe fittings (Rc 3/4") (pipe size ø22)	50-64 84-111 147-185	46-085-2125
5	€=₽	Low Vi plug (Rc 3/4")	50-64 85-111 147-185	77-193-2045

Issued March 1, 1997 Screw Compressor GSV Block Sheet 2-40-043

New Discharge Pressure Valve GVD for GSV and GSB Compressors

GSV and GSB units with compressor sizes 50-185 will, from around 1st December 1994, be fitted with a newly developed discharge pressure valve. See sectional drawing below. GSV and GSB units with compressor sizes 263-465 will be fitted with the new valve from around 1st May 1995.

The new valve is recognisable by the long bolts that hold the cover and cylinder in place, and the tube that runs from pos. 24 to the suction side of the compresor.

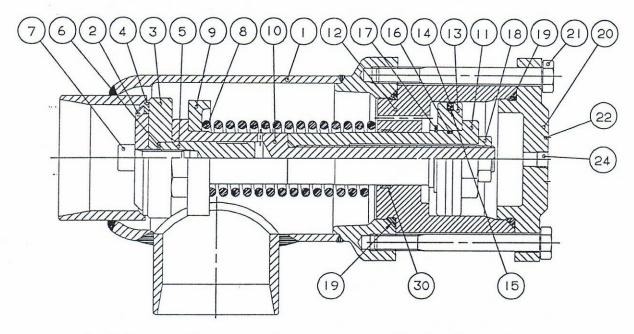

The new GVD valve is force-controlled so that when pressure in the oil separator becomes 2 bar higher than the suction pressure, the spring is compressed and the valve opens. In low-pressure units (boosters), the spring requires a differential pressure of 1 bar for the valve to open. The round label on the valve end cover indicates which spring is fitted.

The new valve offers four significant advantages in comparison with traditional non-return valves:

- 1. no chatter at part-load
- 2. no pressure drop because of spring force
- high closing force on the cone during standstill, even without differential pressure across the valve
- 4. fast build-up of oil pressure in oil separator during start-up.

re 1/2: Since the valve is force-controlled, the flow must not overcome the spring force, i.e. the spring is

All information given above is subject to change without notice

compressed by the difference between the pressure in the oil separator and the suction pressure.


re 3: The closing force is about ten times higher in GVD than in traditional non-return valves.

re 4: Especially on units without oil pump, it can be difficult, when starting to build up oil pressure in the oil separator, to drive oil forward to the compressor. For example, if there is no pressure in the condenser when the unit is started because pressure must be built up in both condenser and oil separator before oil is driven forward to the compressor.

Since the new GVD valve cannot be shut off manually, a GV shut-off valve will also be fitted on the units. This provides the possibility of servicing the new valve, whereas on earlier units the non-return valve could not be serviced because it was a combined stop and non-return valve.

Issued March 1, 1997 Screw Compressor GSV Block Sheet 2-40-044

The GVD valve is to be connected as shown below (with P+I diagram symbols)

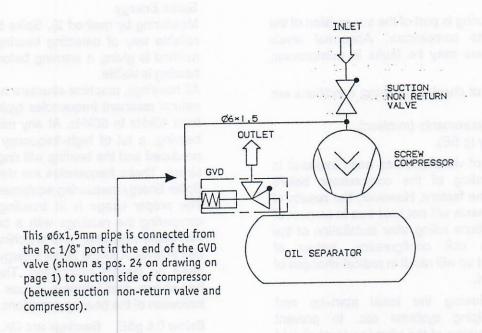

NOTE:

The GVD valve cannot be used on compressor units where the non-return valve is placed between compressor and oil separator instead of on the suction side of the compressor. The reason for this is that the GVD valve needs to have the Ø6x1,5 mm pipe connected to a point on the compressor unit, where the pressure is low during running and high during standstil.

The GVD valve must be mounted so that the cylinder is placed horizontally. This will ensure correct function of the valve and make service more friendly. Please remember to dismantle the valve when welding is made.

Following part numbers can be used when ordering the valve separately:

GVD for high pressure duty	Part no.	GVD for low pressure duty	Part no.
DN 65	77-257-0570	DN 65	77-257-0571
DN 80	77-257-0572	DN 80	77-257-0573
DN 100	77-257-0574	DN 100	77-257-0575
DN 125	77-257-0576	DN 125	77-257-0577
DN 150	77-257-0578	DN 150	77-257-0579

ISSUED January 1, 1995 SHEET NO. 2 40 55

Technical Data

Screw Compressor Type GSV/GSB Vibration Measuring

Introduction

Vibration measuring is part of the supervision of the condition of the compressor. Abnormal levels indicate that there may be faults in compressor, drive or motor.

Here two ways of checking bearing conditions are mentioned.

- 1. Velocity measurements (mm/sec).
- 2. Spike Energy (g SE).

The measuring of vibrations has been included in the general testing of the compressor before despatch from the factory. However, the results of these measurements will not hold true in respect of the actual conditions ruling after installation of the compressor as unit configuration, nature of operation and set up will result in radical changes of the vibration level.

Immediately following the initial start-up and insulation of piping systems etc. to prevent vibration, a measuring of the vibration level should be carried through and the results of this measurement will now serve as future reference values for measurements made according to the schedule below.

Measuring of relocity

Measuring by method 1) mentioned above, vibration levels should be below 6 mm/sec (rms). If the values are above this, vibration measuring should be taken more often than recommended to follow the developement of the vibration level. At values above 12 mm/sec (rms) the compressor needs an overhaul.

The values (limits) given here are typical values. As vibration level is depending on the installation of the compressor, the development of the vibration level tells more about the bearing conditions than the actual value itself. An accelerating increase in level indicates that it is time to give the compressor an overhaul.

sheet 2 40 56 has earlier given the actual frequencies ruling with failures in bearing innerrace, outerrace and ball or roller. These frequencies could point out the bearing with a failure. As measuring of all these frequencies needs very special and expensive equipment we have removed these values. Furthermore, if the compressor is to be opened, all bearings are to be changed anyway.

All information given above is subject to change without notice.

Spike Energy

Measuring by method 2), Spike Energy, is a more reliable way of detecting bearing failures, as the method is giving a warning before the failure of a bearing is visible.

All housings, machine structure and bearings have natural resonant frequencies typically in the range from 10kHz to 50kHz. At any minor damage of a bearing, a lot of high-frequency energy is being produced and the bearing will ring like a bell being struck. These frequencies are detectable by using Spike Energy measuring equipment.

The proper usage is in trending the levels (i.e., comparing the readings with a baseline taken for that same machine), and watching for the relative rise in level. A single Spike Energy reading by itself gives no distinct information. Though experience has shown, that following values can be used for indication of the bearing conditions:

Below 0.5 gSE Bearings are OK.

Above 0.5 gSE Measurings more often than recommended are to be made.

Above 2.0 gSE An overhaul is needed.

The best solution is to make measurements with both methods. Gram offers equipment which is able to make both types of measurements.

Measuring procedure

The recommended schedule for making measurements is:

50h - 1,000h - 5,000h - 10,000h - 15,000h etc.

If measurements are made from the beginning the paint is not to be scraped of at the measuring points. If measurements are made on an "old" compressor (without reference measurements) it is recommended to scrape of the paint and use the values above to indicate the bearing conditions.

- 1. The measuring points are to be marked with the numbers shown on sheet 2 40 56.
- The compressor control is put into manual operation and some reasonable values for Vi and capacity are entered. These values as well as the other running conditions should be the same at future measurements.
- 3. Make measurements for both Spike Energy and velocity and note the values in the operating log.
- 4. After measurements are made, the compressor control is put into normal operation mode....

ISSUED January 1, 1995 SHEET NO. 2 40 56

Technical Data

Screw Compressor Type GSV/GSB Vibration Measuring

The measuring poin	ts are indicated	on the draw	ings belov	W		Date		CONTRACTOR OF THE PARTY
		<u>चित्र विव्याम विव्याम</u>		7(8) (3(4)			(5)(0)	
Vibration level				8 4		GS+ - :	(D) (S)	
Chang	ge bearings	7			€ \ ₺			
		Time	.π .					
							1 1	
his sheet can be us	end for logging	data		0 3	77-257-9226	001 004	ම ම	
				. crol o	77-257-9226			
Customer	:			Order no	77-257-9226	268		
Customer				Order no Compresso	77-257-9226 or type	268		
Customer Plant designation Compr. part/serial n	0			Order no Compresso Refrigerant	77-257-9226 or type	nieni neli		
Customer Plant designation Compr. part/serial n	0	bar Ps	истюй	Order no Compresso Refrigerant *C Output_	77-257-9226 or type	nieni neli		
customer lant designation compr. part/serial n tunning timet	0	<u>bar</u> P _{si} Spike Enerç	uction	Order no Compresso Refrigerant °C Output Measuring poi	77-257-9226 or type	Ar	npere	%
Customer Plant designation Compr. part/serial n	OO_PDISCHARGE	<u>bar</u> P _{si} Spike Ener <u>c</u>	истюк gy (g SE) 5	Order no Compressor Refrigerant C Output Measuring poi	77-257-9226 or type % Vi_ nt no7	nieni nesi	npere	
CustomerPlant designation Compr. part/serial n Running timet	O PDISCHARGE	<u>bar</u> P _{si} Spike Ener <u>c</u> 4 Velocity (m	истюк gy (g SE) 5_ nm/sec)	Order no Compressor Refrigerant C Output Measuring poin 6 Measuring poin	77-257-9226 or type % Vi nt no. 7	Ar	npere	<u>%</u> 9
CustomerPlant designationCompr. part/serial natural	PDISCHARGE 3	bar P _{si} Spike Energ 4 Velocity (m	истюк gy (g SE) 5	Order no Compressor Refrigerant C Output Measuring poi	77-257-9226 or type % Vi_ nt no7	Ar	npere	%
CustomerPlant designationCompr. part/serial natural	PDISCHARGE 3	bar P _{si} Spike Energ 4 Velocity (m	истюк gy (g SE) 5_ nm/sec)	Order no Compressor Refrigerant C Output Measuring poin 6 Measuring poin	77-257-9226 or type % Vi nt no. 7	Ar	npere	<u>%</u>
CustomerPlant designationCompr. part/serial natural	PDISCHARGE 3	bar P _{si} Spike Energ 4 Velocity (m	истюк gy (g SE) 5_ nm/sec)	Order no Compressor Refrigerant C Output Measuring poin 6 Measuring poin	77-257-9226 or type % Vi_ nt no. 7 ot no. 7	Ar	npere	<u>%</u>
Plant designation Plant designation Compr. part/serial n Running timet2	O	bar P _{si} Spike Energ 4 Velocity (m	истюк gy (g SE) 5_ nm/sec)	Order no Compressor Refrigerant C Output Measuring poin 6 Measuring poin	77-257-9226 or type % Vi_ nt no. 7 ot no. 7	Ar	npere	% 9 9
CustomerPlant designation Compr. part/serial n Running timeh	O PDISCHARGE 3 also be made or	bar Psi Spike Energed 4 Velocity (mage) 4 n the motor:	остюк	Order no Compressor Refrigerant C Output Measuring poin 6 Measuring poin 6	77-257-9226 or type	Ar	npere	<u>%</u> 9
	O PDISCHARGE 3 also be made or	bar Psi Spike Energed 4 Velocity (mage) 4 n the motor:	остюн	Order no Compressor Refrigerant C Output Measuring poin 6 Measuring poin 6	77-257-9226 or type	Ar	npere	<u>%</u> 9


ISSUED Februar 1, 1987

SHEET NO. 2 40 65

Technical Data

GSV NH3


Part Load Performance vs. Compression Ratio

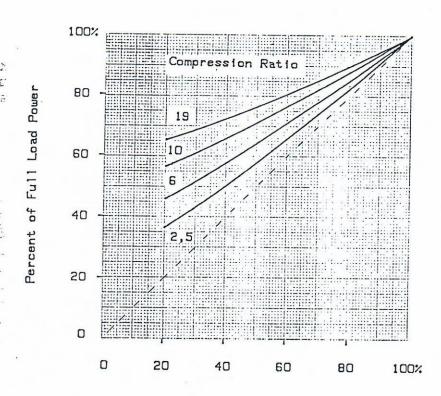

Percent of Full Load Capacity

Economizer Port Pressure vs. Evaporation Temperature

Remark: At No load.

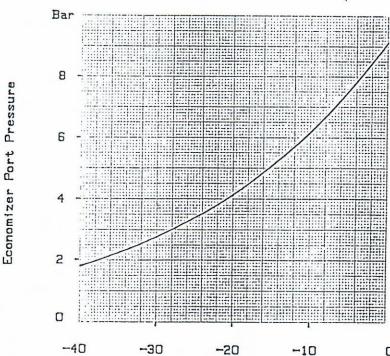

Evaporation Temperature

O° C

Technical Data

Screw Compressor Unit Type GSV Sound Pressure Level (SPL)

For a GSV screw compressor unit at average operating conditions (running speed 2950 rpm and discharge pressure 35°C), the airborne sound pressure level in decibel will be as shown below.

Measurements are taken in accordance with ISO 3744 and the distance L is 2.0 m, taken in a free field and on a plane surface.

Octave Band Center	Sound Pressure Level, (dB) GSV 50-64	Sound Pressure Level, (dB) GSV 84-111	Sound Pressure Level, (dB) GSV 147-185	Sound Pressure Level, (dB) GSV 263-331	Sound Pressure Level, (dB) GSV 412-562
Frequency Hz	74	74	74	74	73
62,5	72	73	75	78	76
125,0 250,0	78	81	84	86	78
500,0	81	81	82	88	86
1000,0	79	79	81	81	83
2000,0	72	72	73	75	82
4000,0	65	65	67	67	80
8000,0	62	62	65	65	79
Average dB(A)	82	83	84	87	87

Corrections:

Re: 20 μpascal (Treshold of hearing).

Correction for measuring distance L ≠ 2m:

Correction = 10 * log(
$$\frac{2}{4*\pi*L^2}$$
) + 14

Correction of the average value dB(A) at operating conditions different from above. Actual average value:

$$dB(A)_x = dB(A)_s + 0.15 * (P_x-35) + 0.004 * (n_x-2950)$$


Where dB(A)_s = average value at standard operating conditions, see table
P_x = actual discharge pressure, °C
actual running speed, rpm

Notes:

- 1. Additional equipment, such as motors, heat exchangers, pressure vessels, piping, and valves may increase noise levels measured at the installation. The above noise levels reflect the noise contribution from a specific type of oil separators designed for a range of operating conditions. Due to the unpredictable nature of gas pulsations, and the wide range of possible application of this type of equipment, actual levels achieved in a plant may be higher or lower than indicated above.
- The acoustic nature of the surroundings in which a unit is mounted and located may alter the charactereristic and level of noise. Such con-ditions are out of our control.

Issued March 1, 1997 Screw Compressor Sheet 2-42-021

GSV Screw Compressor Unit Dimensions.

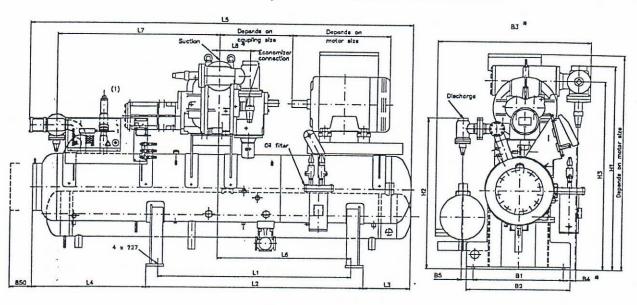

		GSV 50	GSV 64	GSV 84	GSV 111	GSV 147	GSV 185
L1	mm	1600	1600	1750	1750	1900	1900
L2	mm	1820	1820	1970	1970	2160	2160
L3	mm	545	545	420	420	650	650
L4	mm	980	980	1010	1010	1480	1480
L5	mm	3400	3400	3430	3430	4400	4400
L6	mm	935	965	1220	1265	1425	1465
L7	mm	1605	1575	1440	1395	1920	1885
L8	mm	240	280	280	360	360	500
B1	mm	800	800	800	800	1000	1000
B2	mm	920	920	920	920	1120	1120
B3 (3)	mm	1230	1325	1355	1470	1618	1758
B4	mm	45	105	110	155	93	168
B5	mm	75	75	110	110	115	115
H1	mm	1685	1725	1855	1910	2175	2285
H2	mm	1260	1260	1370	1370	1630	1630
Н3	mm	1565	1585	1715	1730	1995	2035
Suction	mm	DN 100	DN 125	DN 125	DN 150	DN 150	DN 200
Discharge	mm	DN 65	DN 65	DN 80	. DN 80	DN 100	DN 100
Diameter oil sep.	mm	500	500	600	600	750	750
Oil charge sep.	mm	210	210	325	325	600	600
Weight less motor/oil	kg	2200	2400	2700	2900	4500	4500
Shipping volumen max.	m ³	7.6	7.6	8.4	8.4	13.9	13.9


⁽¹⁾ See Design Data page 2.70.101 and 2.70.102 for connection of bypass valve.

⁽²⁾ Dimension of oil cooler, see page 2.42.33 or 2.42.34

All dimensions are subject to confirmation.

Issued March 1, 1997 Screw Compressor Unit Sheet 2-42-022

Screw Compressor Unit Type GSV 263 and GSV 331

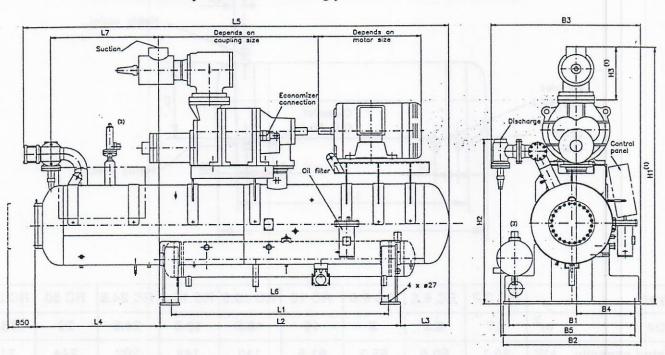

		GSV 263	GSV 331
L1	mm	2400	2400
L2	mm	2660	2660
L3	mm	555	555
L4	mm	1380	1380
L5	mm	4710	4710
L6	mm	2540	2640
L7	mm	1190	1090
B1	mm	1400	1400
B2	mm	1530	1530
B3	mm	1700	1700
B4	mm	650.	650
B5	mm	1495	1495
H1 (1)	mm	2900	2900
H2	mm	1850	1850
H3 (1)	mm	610	610
Suction	mm	DN 200	DN 200
Discharge	mm	DN 125	DN 125
Diameter oil sep.	mm	900	900
Oil charge sep.	ltr.	850	850
Net weight less motor/oil	kg	6100	6100
Shipping volume max.	m 🗆	21.4	21.4

Dimensions are only valid for NH3. For other refrigerant, ask Gram Refrigeration.

- (1) At removal of suction valve, max. unit height will be: H1 -H3 + 50.
- (2) See Design Data page 2.70.101 and 2.70.102 for connection of bypass valve.
- (3) Dimension of oil cooler, see page 2.42.33 or 2.42.34.

All dimensions are subject to confirmation


ISSUED March 1, 1992

SHEET NO. 2 42 33

Technical Data

GSV/GSB

Screw Compressor, Oil Cooler type RC (refrigerant cooled)

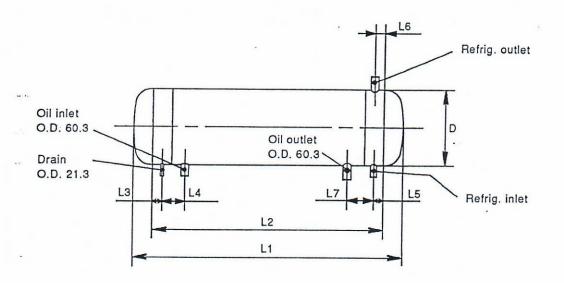

Commence of the commence of th										
Type		RC 3.7	RC 6.2	RC 8.0	RC 10	RC 13.5	RC 18.3	RC 24.8	RC 30	RC 38.2
Size	m ²	3.7	6.2	8	10	13.5	18.3	24.8	30	38.2
Rated capacity	/ kW	30.1	50.5	65.2	81.5	110	149	202	244	311
Oil charge	ltr.	30	50	50	64	88	119	178	216	275
D		219.1	219.1	244.5	244.5	323.9	323.9	400	400	400
L ₁		1870	2910	2945	3195	2570	3320	2790	3270	4200
L ₂		1740	2780	2745	3025	2350	3100	2540	3020	4450
L3		40	40	40	50	40	40	40	40	40
L4		125	125	130	130	125	125	125	125	125
L ₅		55	. 55	90	90	60	60	70	70	70
L ₆		55	55	75	75	60	60	70	70	70
L ₇ .		140	140	155	155	145	145	155	155	155
Refrig. inlet	O.D.	33.7	33.7	48.3	48.3	48.3	48.3	60.3	60.3	60.3
Refrig. outlet	O.D.	48.3	48.3	60.3	60.3	60.3	60.3	76.1	76.1	76.1
Weight	Kg	175	280	325	360	470	580	690	815	1.120

Rated capacity has been calculated for:

 $T_{\text{oilin}} = 85^{\circ}\text{C} (185^{\circ}\text{F})$

 $T_{\text{oilout}} = 50^{\circ}\text{C} (122^{\circ}\text{F})$

 $T_{COND} = 35^{\circ}C (95^{\circ}F)$

 $= 29.1^{\circ}C (84.2^{\circ}F)$ Δtm

Heat transfer coefficient: 0.28 kW/m² °C.

All information given above is subject to change without notice

$$\Delta_{tm} = \frac{(T_{oilin} - T_{cond.}) - (T_{oilout} - T_{cond.})}{L_{n} \frac{(T_{oilin} - T_{cond.})}{(T_{oilout} - T_{cond.})}}$$


The oil coolers are not tied up with a specific compressor size (GSV/GSB), The exact cooler size is selecte in the VKAT calculation programme (which can also be used for the preparing of calculations).

ISSUED March 1, 1992 SHEET NO. 2 42 34

Technical Data

GSV/GSB

Screw Compressor, Oil Cooler type WC (water cooled)

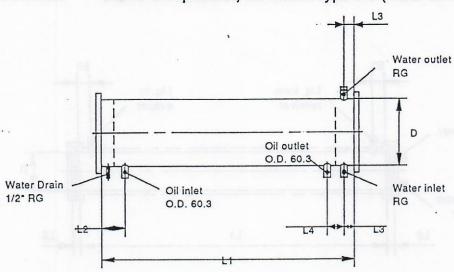

Type		WC 3.7	WC 6.2	WC 8.0	WC 10	WC-13.5	WC 18.3	WC-24.8	. WC 30	WC 38.2
Size	m ²	3.7	6.2	8	10	13.5 -	. 18.3 .	-24.8	. : 30 .	.38.2
Max. water flow V	m ³ /h	11.5	11.5	17.2	17.2	30.1	30.1	51.1	51.1	. 51.1
Rated capacity	kW	31.5	52.7	68.0	85	115	156	211	255	325
Pressure drop	K	10	11	5.4	5.8	1.8	2.0	0.5	0.6	0.7
Oil charge	ltr.	30	50	50	64	88	119	178	216	275
D		219.1	219.1	244.5	244.5	323.9	323.9	400	400	400
L ₁		1700	2675	2325	2925	2360	3110	2645	3125	3875
L ₂		100	100	130	130	155	155	185	185	185
L3		45	45	45	45	70	70	125	125	125
L4		130	130	140	135	155	155	185	185	185
Water outlet inlet	RG	1 1/4"	1 1/4"	1 1/2"	1 1/2"	2"	2"	2 1/2"	3"	3"
Weight	Kg	180	285	330	370	480	590	715	830	1.145

Rated capacity has been calculated for:

Toil in = 85°C (185°F)

Toil out = 50°C (122°F)

Twater in = 30°C (86°F)

Twater out = 35°C (95°F)

 $\Delta_{tm} = 32.7^{\circ}C (91^{\circ}F)$

Heat transfer coefficient: 0.26 kW/m2 °C.

The oil coolers are not tied up with a specific compressor size (GSV/GSB). The exact cooler size is selected in the VKAT calculation programme (which can also be used for the preparing of calculations).

$$\Delta_{tm} = \frac{(Toil\ in - Twater\ out) - (Toil\ out - Twater\ in)}{L_n \frac{(Toil\ in - Twater\ out)}{(Toil\ out - Twater\ in)}}$$

Capacity: Surface x Δ_{tm} x heat transfer coefficient. Calculation of pressure drop: Pressure drop (mm w.g.) = (water flow [m3/s] x factor K x 10⁵)

Note.

Oil cooler is of cross flow type means that $T_{\text{oil out}}$ must bee at least 10°C over $T_{\text{water out}}$.


Toil out ≥ (Twater out + 10°C)

ISSUED March 1, 1992

SHEET NO. 2 42 35

Technical Data

GSV/GSB Screw Compressor Economizer EZ (enclosed design)

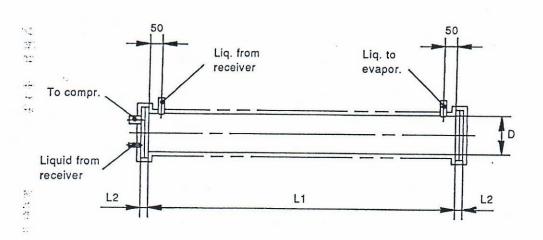

Refrigerant	Ammonia (R 717)				Freon (R 22 - R 502)			
Compressor	50-64	84-111	147-185	263-331	50-64	84-111	147-185	263-331
Туре	EZ 1	EZ 2	EZ 3	EZ 4	EZ 11	EZ 12	EZ 13	EZ 14
D	139.7	139.7	139.7	168.3				
L1	1.300	2.000	3.000	3.300				
L2	50	50	50	60				
Liquid from receiver O.D.	42.4	42.4	48.3	60.3				
Liquid to evaporator O.D.	42.4	42.4	48.3	60.3				
Liquid from receiver O.D.	21.3	21.3	21.3	26.9				
Injection to compr. O.D.	42.4	42.4	48.3	60.3				
Weight Kg	75	95	120	155				

Economizer type EZ is rated for cooling of liquid refrigerant to 10°C above economizer pressure at 3.000 rpm and normal conditions.

ISSUED April 1, 1990 SHEET NO. 2 42 65

Technical Data


GSV/GSB Screw Compressor Motor Selection and Starting Torque

Motors must be sized adequate for all expected operating conditions since start up, pull down and load variations quite often require significantly more horsepower than nominal design.

Motor starting torque capacity must also be considered, especially when another than across-the-line start is employed. Motor starting and pull-up-torque must be at least 20% greater


Speed Vs Torque Fully unloaded.

Example:



than compressor requirements at maximum expected start-up conditions. Refer to the torque data below.

Note: Motor starting torque varies considerably with various manufacturers -obtain specific torque data for the motor being used.

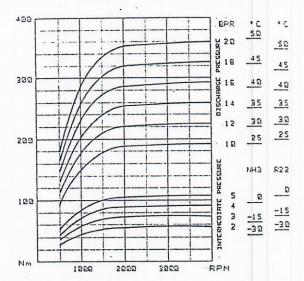

Motor A will start the compressor, B will not.

Model no. GSV/GSB/GSF	Starting Torque Multiplier	Break-away Torque Nm	Inertia I kgm²
GSV 50	0.46	9.5	0,13
GSV 64	0.58	9.5	0,15
GSV 84	0.75	13.6	0.30
GSB 84	1.50	13.6	0.30
GSV 111	1.00	13.6	0.34
GSB 111	2.00	13.6	0.34
GSV 147	1.27	19.0	0.59
GSB 147	2.64	19.0	0.59
GSV 185	1.60	19.0	0.72
GSB 185	3.32	19.0	0.72
GSV 263	2.28	27.2	1.48
GSB 263	4.72	27.2	1.48
GSV 331	2.87	27.2	1.81
GSB 331	5.96	27.2	1.81
GSV 412	3.72	33.9	4.33
GSB 465	8.10	31.2	2.44
GSV 562	5.10	33.9	4.92

Remark: Flywheel effect GD2= 4 x I with I in kgm2 and GD2 in kpm2

Starting Torque for Any Specific Compressor. Multiply starting torque multiplier by starting torque value from curves at 100% of normal running speed. Calculation example:

GSV 185, NH₃ at 2950 RPM and 31°C discharge pressure (≈12 bar)

starting torque multiplyer GSV 185 = 1.60 starting torque at 12 bar = 225 Nm.

GSV 185 starting torque = 1.60 x 225 = 360 Nm

Motor/Compressor Torque:

Assure that the motor starting and minimum pull-

up torque capabilities will exceed the compressor requirements at the anticipated condition that will be experienced during normal starting (see example).

Note: Wye-delta and autotransformer (reduced voltage) motor starting methods drastically affect the starting torque available from motors as indicated.

Across-the-line: 100% Auto Transformer: 25-64%

Wye-delta: 25-33%

ISSUED April 1, 1991 SHEET NO. 2 50 01

Technical Data

GSB Screw Compressor Description

Description

The seven (7) models of the Gram GSB Rotary Screw Compressor units described herein range in capacity from 835 m³/h to 4646 m³/h at 2950 rpm. Standard units are designed for use on ammonia, halocarbon and hydrocarbon refrigerants at pressure ratios up to 26:1.

GSB Rotary Screw Compressor Units consist of the following major components: - Rotary Screw Compressor, oil pump and filter; drive coupling and guard; combined stop and check valve and filter on suction side. Combined stop and check valve on the discharge side; suction scale trap with strainer, and a three stage horizontal oil separator/reservoir. All components have been selected for maximum reliability and arranged to assure accessibility for service. The units are factory packaged, complete with wiring and piping.

Model GSB Compressor

Housing - All screw compressor castings are designed and tested to meet the requirements of common standard for 25.0 bar maximum discharge pressure. Castings are close grain cast iron to assure structural integrity, mechanical and thermal stability under all operating conditions.

Rotors - The rotors are machined from AISI-1137 steel forgings to the exacting tolerances of the latest SRM asymmetric profile. The four lobed male rotor is directly connected to the driver. The six lobed female rotor is driven by the male rotor on a thin oil film.

Bearings - Antifriction bearings are used for reduced power consumption, particularly at the higher pressure ratios. Cylindrical roller bearings are provided to handle the radial loads and the thrust loads are absorbed by angular contact ball bearings. In addition, thrust balance pistons are provided to reduce the thrust load and improve bearing life.

Shaft Seal - The compressor shaft seal is a single face type with a spring loaded carbon rotating surface riding against a cast iron stationary seat. The seal is capable of sealing up to 25.0 bar but is vented to low pressure to provide extended seal life.

Lubrication System. The lubrication system on a unit (designed for booster duty) includes a full lube oil pump. The full lube pump is supplied as standard equipment due to the typical low differential pressure across the GSB compressor in booster applications.

Oil Separator/Reservoir - The oil separator is a horizontal, three stage design with integral sump. Two sight glasses are located in the reservoir section and one in the coalescing section. The separator is designed and constructed in accordance with commonistandards for a maximum design working pressure of 25.0 bar and supplied with by-pass valve from discharge to suction. Two heaters maintain oil temperature higher than surrounding during compressor shut-down.

Coalescent separator elements are provided for final gas/oil separation of particles down to less than 1 micron. The oil carry over to the refrigeration plant will normally be less than 10 PPM.

Oil is drained from the coalescer section and returned to the compressor suction during operation.

A float switch is installed in the first stage of the oil separator to detect a low oil level. If a low level occurs the float switch will shut the compressor down.

Oil Filter - All lubrication oil will pass through a $25\mu m$ absolute oil filter ($\beta_{25} \ge 75$ ISO 4572). Solid containcenants will be kept down to code 20/16 after ISO 4406. The filter is furnished with isolation stop valves and drain valve for ease of servicing.

Liquid Injection Oil Cooling - The compressor oil is cooled by direct contact with refrigerant injected through port locations in the compressor discharge. Liquid feed arrangement includes a stop valve, strainer, solenoid valve, metering valve and stop valve. The metering valve will maintain temperature of oil returning to the compressor between 50°C and 70°C. At booster application liquid will be injected into the compressor after the compression has come to an end. This will not affect the capacity.

Water Cooled Oil Cooling - The optional water cooled oil cooler is a shell and tube design with oil on the shell side. The oil temperature is maintained at 50°C - 60°C. As optional an automatically water regulating valve sensing outlet oil temperature can bee supplied.

Thermosyphon Oil Cooling - Maintains oil temperature 10°C - 20°C higher than plant condensing temperature. The optional thermosyphon cooler is a shell and tube design. The oil cooler is mounted on the unit with the oil piping connected. Refrigerant connections and controls are field installed.

Issued March 1, 1997 Flake Ice Machine Type IKV Sheet 2-50-002

GSB Screw Compressor Description

✓ Volume Ratio

The GSB compressor has a fixed inbuilt volume ratio of 2.8. This will normally match the pressure ratios at common booster applications and give efficient operation.


Capacity Control


Capacity Controls is done by 3 plug valves, which gives two steps of capacity reduction to about 75 %, 50% and 25% of full load. The plug valves allow efficent part load operation, by the opening of one or both plugs. The mechanical design of the plugs is simple and the required control is very simple (see sketch) it

is done in the same manner as multicylinder reciprocating compressors. When the plug valves are opened, gas in bypassed back to suction before compression begins and any work is expanded.

Onload Starting

When compressor is not running the plug valves will be opened by the inbuilt return sprigs. Oil pressure to dose the plugs is controlled by solenoid valves which should not be energized before compressor is running at full speed.

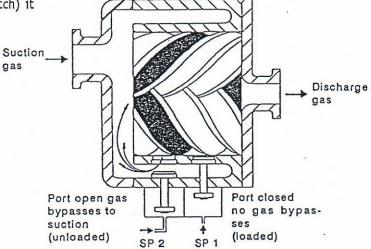


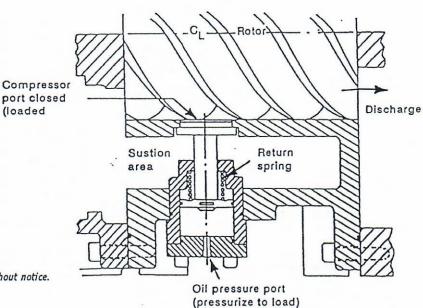

Technical Data

GSB Total Oil Flow

With Oil ISO VG 68, 50°C. Refrigerant ammonia.
(also valid for GSV with small main nozzle)

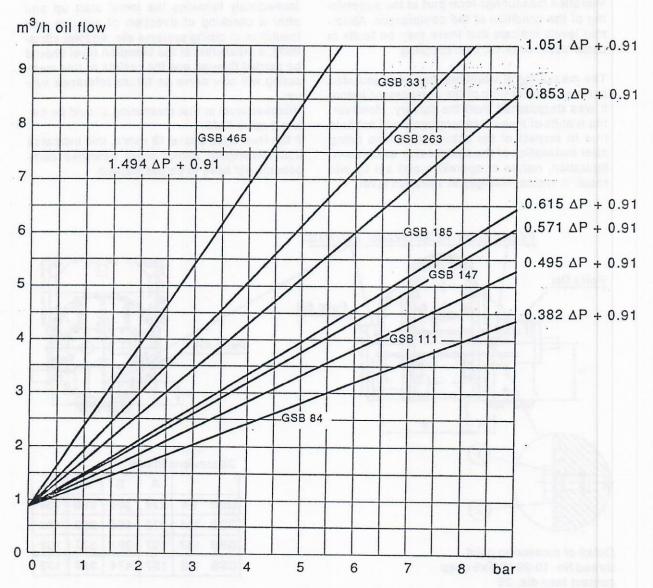

 ΔP : Oil pressure minus suction pressure (P_{oil} - P_{s}) bar.

Oil pressure is discharge pressure plus oil pump differential minus filter pressure drop.

Oil pressure should be 1.5 to 3 bar above discharge pressure.

ISSUED April 1, 1991 SHEET NO. 2 60 55

Technical Data

GSB 84-111-147-185 Screw Compressor

Vibration Measuring


Vibration measurings form part of the supervising of the condition of the compressor. Abnormal levels indicate that there may be faults in compressor or drive, incl. coupling.

The measuring of vibrations has been included in the general testing of the compressor before it was despatched from the factory. However, the results of these measurements will not hold true in respect of the actual conditions ruling after installation of the compressor as unit configuration, nature of operation and set up will result in radical changes in vibration level.

Immediately following the initial start up and after a checking of direction of rotation and insulation of piping systems etc. against vibrations, a measuring of the vibration level should be carried through and the results of this measuring will now serve as future reference values.

Vibration level at first measuring should be below 6 mm/s RMS.

If the level rises above 12 mm/s, this indicates that compressor and/or other defective components will have to be overhauled.

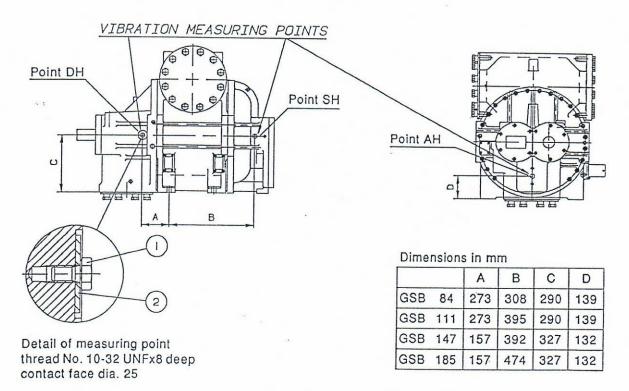

Surfaces shall be clean, flat and machined smooth to manufacturer's tolerances where specified. The axes of the stud mounting holes shall be square to the mounting surface.

The manufacturer's recommended mounting torque shall be used to obtain a firm fixing without damaging the accelerometer.

A thin film of oil or grease between the surfaces

helps to achieve good contact and thus maximum stiffness.

The stud shall not bottom in the mounting holes as rigidity may be lost owing to a small gab between the surfaces. (According to ISO 5348 pkt.5.4.2)


For typical frequencies, see frequency tabel,

ISSUED April 1, 1991 SHEET NO. 2 60 56

Technical Data

GSB 84-111-147-185 Screw Compressor

Vibration Measuring

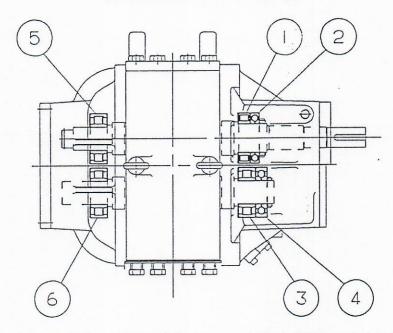


Frequency table showing connection with 2-poled motors and 50 c/s (2950 rpm). At other running speeds the frequencies are changing correspondingly.

Screw Compressor GSB	84-111 (Hz)	147-185 (Hz)
Roller bearing Item 1 Fault in outer race	254	256
Roller bearing Item 1 Fault in inner race	385	384
Roller bearing Item 1 Roller defect	190	197
Ball bearing Item 2 Fault in outer race	232	220
Ball bearing Item 2 Fault in inner race	309	321
Ball bearing Item 2 Ball defect	251	182
Roller bearing Item 3 Fault in outer race	169	171
Roller bearing Item 3 Fault in inner race	257	256
Roller bearing Item 3 Roller defect	127	131
Ball bearing Item 4 Fault in outer race	146	147
Ball bearing Item 4 Fault in inner race	215	214
Ball bearing Item 4 Ball defect	119	121
Roller bearing Item 5 Fault in outer race	254	254
Roller bearing Item 5 Fault in inner race	385	385
Roller bearing Item 5 Roller defect	191	192
Roller bearing Item 6 Fault in outer race	169	169
Roller bearing Item 6 Fault in inner race	257	257
Roller bearing Item 6 Roller defect	127	128
Revolution frequency	49.2	49.2
Magnetizing frequency in electric motor	100	100
Pump frequency, tooth frequency from compressor	196.7	196.7

Issued March 1, 1997 Screw Compressor Unit Sheet 2-62-022

Screw Compressor Unit Type GSB 263, 331 and 465

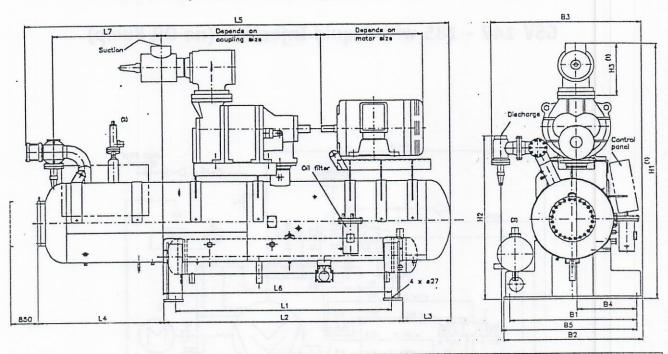


		GSB 263	GSB 331	. GSB 465
L1.	mm	2400	2400	2400
L2	mm	2660	2660	2660
L3	mm	555	555	605
L4	mm	1380	1380	1435
L5	mm	4710	4710	4900
L6	mm	2540	2640	2950
L7	mm	1190	1090	850
B1	mm	1400	1400	1400
B2	mm	1530	1530	1530
B3	mm	1700	1700	1750
B4	mm	650	650	650
B5	mm	1495	1495	1540
H1 (1)	mm	2900	2900	3000
H2	· mm	1850	1850	2050
H3 (1)	mm	610	610	710
Suction	mm	DN 200	DN 200	DN 250
Discharge	mm	DN 125	DN 125	DN 150
Diameter oil sep.	mm	900	900	1100
Oil charge sep.	ltr.	850	850	1200
Net weight less motor/oil	kg	6100	6100	6600
Shipping volume max.	m³	21.4	21.4	23

Dimensions are only valid for NH3. For other refrigerant, ask Gram Refrigeration.


- (1) At removal of suction valve, max. unit height will be: H1 -H3 + 50.
- (2) See Design Data page 2.70.101 and 2.70.102 for connection of bypass valve.
- (3) Dimension of oil cooler, see page 2.42.33 or 2.42.34.

· : : . · . . Issued August 1, 1997 Group 2, Screw Compressors GSV Sheet 2-70-030

GSV 147 - 185 with Liquid Injection (no Oil Pump)

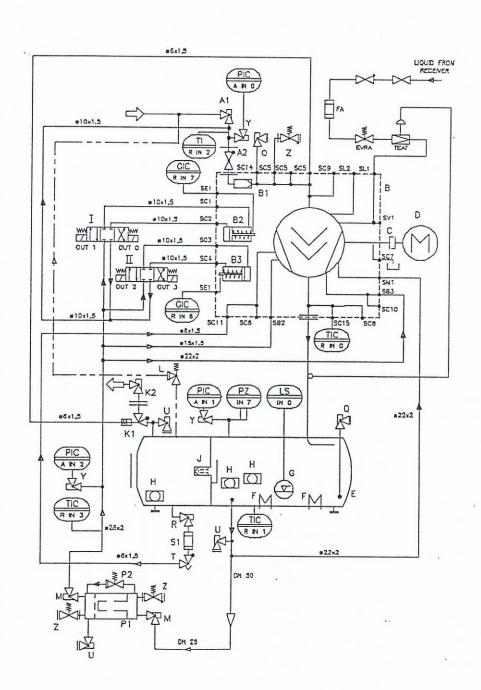

GSV 147 - 185 with Liquid Injection (no Oil Pump)

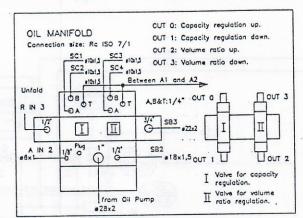

MAIN PARTS:

A1 : Suction Shut off Valve

A2 : Suction Non Return Valve

- B: Screw Compressor GSV. B1: Suction Strainer B2: Capacity Piston. B3: Volume ratio Piston
- C: Coupling
- D: Compressor Motor
- E: Harisantal Oil Separator #700
- F: Oil Heater 890W (400 V)
- G: Level Switch
- H: Sight Class
- J : Coalescer Filter
- K1 : Special Non Return Valve DN 100
- K2 : Discharge Shut off Valve
- L: Safety Bypass Valve
- M: Service Shut Off Valve GV 25
- P1 : Oil filter, 825=75
- P2 : Oil Bypass Valve 2,5 bar.(Built into Filter)
- Q: Oil Filling Valve GVAC 15
- R: Shut Off Valve GV 15
- S1: Oil Strainer FA 15
- T: Needle and Non Return Valve GRC
- U: Drain GVAC 15
- Y: Shut Off Valve 1/4"
- Z: Access Valve Coupler 7/16" UNF

CHECK POINTS:

R IN 0 :Discharge Temperature PT 100

R IN 1 : Oil Temperatur (Separator) PT 100

R IN 2 :Suction Temperature PT 100

R IN 3 :Oil Temperature (Compressor) PT 100

R IN 6 : Volume Ratio Piston Position

R IN 7 : Capacity Piston Position

A IN O :Suction Pressure (Transmitter -1-+6 bar g)

A IN 1 :Discharge Pressure (Transmitter 0-25 bar g)

A IN 2 :Oil Pressure at Compressor (Transmitter 0-25 bar g)

IN 0 :Level Switch


IN 7 :High Disch. Pressure Switch KP7ABS (preset 17 bar DBK/23 bar SDBK) man reset

Compressor Block B limited by hidden line (-----)

COMPRESSOR CONNECTIONS:


Connection Designation	Size Rc ISO 7/1	Description
SC-1	1/4"	Slide Valve - Unload
SC-2	1/4"	Slide Valve - Load
SC-3	1/4"	Moveable Slide Stap - Increase Vi
SC-4	1/4"	Moveable Slide Stop - Decrease Vi
SC-5	1/4"	Suction Pressure
SC-6	1/4"	Discharge Pressure
SC-7	1/4"	Seal Drain
SC-8	1.	Closed Thread Pressure
SC-9	1/4*	Suction Pressure
SC-10	3/4"	Discharge Bearings Prelube (optional)
SC-11	3/4"	Closed Thread Pressure
SC-13	1/4"	Oildrain Cylinder
SC-14	1/2"	Suction Pressure (Oilfill Volve)
SC-15	1/2"	Discharge Pressure/Temperature
58-2	1/2	Oil Inlet (Inlet Bearings and Balance Piston)
SB-3	3/4"	Oil Inlet (Discharge Bearings and Seal)
SE-1	1/2"	Electrical Connection
SM-1	3/4"	Main Oil Injection
SV-1	•38	Vapor Injection Economizer
SL-1	3/4"	Low Vi Liquid Injection
SL-2	3/4"	High Vi Liquid Injection

GSV 147-185 with Oil Pump, Oil Cooler and Economizer

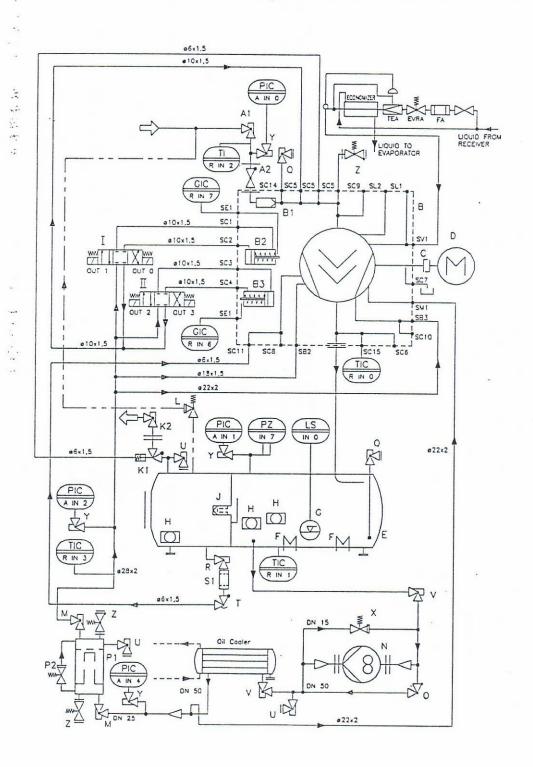

.. .

GSV 147-185 with Oil Pump, Oil Cooler and Economizer

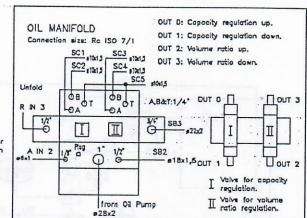

MAIN PARTS:

- A1 : Suction Shut off Yalve
- A2 : Suction Non Raturn Valve
- B: Screw Compressor GSV. B1: Suction Strainer B2: Capacity Piston. B3: Volume ratio Piston
- C: Coupling
- D: Compressor Motor
- E: Harisantal Oil Separator #750
- F: Oil Heater 890W (400 V)
- G: Level Switch
- H: Sight Glass
- J: Codlescer Filter
- K1: Special Non Return Valve DN 100
- K2: Discharge Shut off Valve
- L: Safety Bypass Valve
- N: Service Shut Off Valve GV 25
- N: Oil Pump GP 42 EFM
- O: Non Return Yaive GVC 50
- P1 : Oil Filter, 825-75
- P2 : Oil Bypass Valve 2.5 bar. (Built into Filter)
- Q: Dil Filling Valve GVAC 15
- R: Shut Off Valve GV 15
- 51:Dil Strainer FA 15
- T: Needle and Non Return Valve GRC
- U: Drain GVAC 15
- V: Shut Off Yalve GV 50
- X: Safety Bypass Valve (3 bar)
- Y: Shut Off Yalve 1/4"
- Z: Access Yalve Coupler 7/16" UNF


COMPRESSOR CONNECTIONS:

Connection Designation	Size Rc 150 7/1	Description
5C-1	1/4"	Slide Valve - Unload
SC-2	1/4"	Slide Valve - Load
SC-3	1/4"	Novemble Slide Stop - Increase Vi
SG-4	1/4"	Novemble Slide Stop - Decrease YI
SC-5	1/4"	Suction Pressure
SC-8	1/4°	Discharge Pressure
SC-7	1/4"	Seq! Drain
SC-B	1"	Closed Thread Pressure
SC-9	1/4"	Suction Pressure
SC-10	3/4"	Discharge Bearings Prelube (optional)
SC-11	3/4"	Closed Thread Pressure
5C-13	1/4"	Oildrain Cylinder
5C-14	1/2"	Suction Pressure (Oilfill Yalve)
SC-15	1/2"	Discharge Pressure/Temperature
58-2	1/2"	Oil Inlet (Inlet Bearings and Balance Piston)
28-3	3/4"	Oil Inlet (Discharge Bearings and Seql)
SE-1	1/2°	Electrical Connection
SN-1	3/4"	Ngin Oil Injection
57-1	p38	Vapor Injection Economizer
SL-1	3/4"	Low V Liquid Injection
5L-2	3/4"	High Vi Liquid Injection

CHECK POINTS:

- R IN O : Discharge Temperature PT 100
- R IN 1:01 Temperatur (Separator) PT 100
- R IN 2 : Suction Temperature PT 100
- R IN 3 : Dil Temperature (Compressor) PT 100
- R IN 6 : Valume Ratio Piston Position
- R N 7 : Copacity Piston Position
- A N D : Suction Pressure (Transmitter -1-+6 bar g)
- A IN 1 : Discharge Pressure (Transmitter G-25 bar g)
- A IN 2:01 Pressure at Compressor (Transmitter 0-25 bar g)
- A IN 4 : Dil Pressure before Oil Filter (Transmitter 0-25 bar g)
- IN O :Level Switch
- N 7 :High Diach. Pressure Switch KP7ABS (preset 17 bor DBK/23 bor SDBK) man reset Compressor Black B limited by hidden line (______).

GSV 263-331 with Oil Pump and Oil Cooler

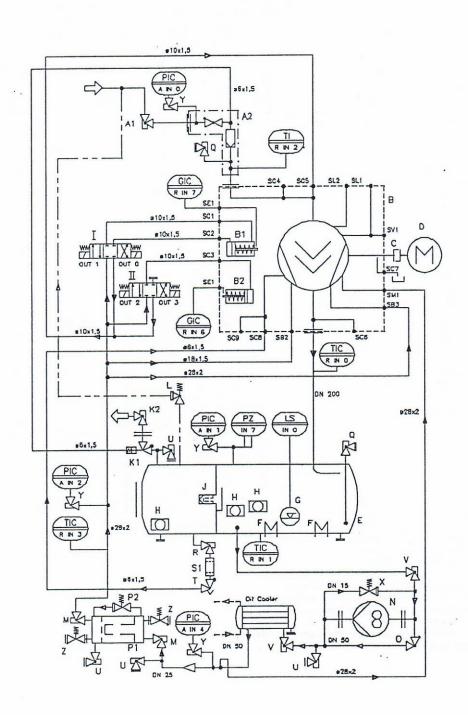

GSV 263-331 with Oil Pump and Oil Cooler

MAIN PARTS:

A1 : Suction Shut off Valve CV

A2 : Suction Non Return Valve and Strainer

B: Screw Compressor GSV B1: Capacity Piston 62. Volume ratio Piston

C: Coupling

D: Compressor Motor

E: Harisontal Oil Separator #300

F: Heater Element 890 W (400 V)

G: Level Smitch

H: Sight Glass

J : Codescer Filter

K1: Special CRAM Non Raturn Volva

KZ: Discharge Shut off Volve

L: Safety Bypass Valve

M: Sarvice Shut Off Valve GY 25

N: 04 Pump GP 52 EFM

D. Non Raturn Volve CVC 50

PI : Oil filter, 825=75

P2 : Oil Bypass Volve 2.5 bor. (Built into Filter)

Q: Oil Filling Volve CVAC 15

R: Shut Off Valve GV 15

S1: Di Stroiner FA 15

T: Needle and Non Return Volve GRC

U: Drain CVAC 15

V: Shut Off Valve GV 50

X: Safety Bypess Valve (3 bar)

Y: Shut Off Valve 1/4"

Z: Access Valve Coupler 7/16" UNF

	ANIFOLD	5 SC3 1015	OUT 1: C	apacity regulati apacity regulati clume ratio up clume ratio do	on down.
Unfald R IN 3	SC2 1100	SC5	S83 #28x		
A IN 2 • 6x1,5	1/8 O	1 1/2	 582 #1&x1.5		OUT 2
		from Oil Pump 28×2	1	I Valve for regulation II valve for ratio regulation	volume

COMPRESSOR CONNECTIONS.

Connection Designation	Size NPTF	Description
50-1	3/8*-18	Slide Valve - Unload
SC-2	3/8'-18	Slide Valve - Lead
SC-3	3/8"-18	Moveable Slide Stop - Increase VI
SC-4	1/2"-14	Inlet Oil Orain (Suction Pressure)
5C-5	3/8'-18	Suction Pressure
5C-6	1/2'-14	Discharge Pressure
SC-7	1/8"-27	Sed Drain
SC-8	1"-111/2	Clased Thread Prassure
50-9	1/4" -111/2	Clased Thread Pressure
58-2	3/4"-14	Oil Inlat (Inlat Bearings and Balance Piston)
58-3	1"-11%	Oil Inlet (Cischarge Bearings and Seal)
SE-1	1/2-14	Electrical Connection
SH-1	1"-111/2	Main Oil Injection
SV-1	2"SQ.Flange	Vapar Injection Economizer
SL-1	1-11/1	Low VI Liquid Injection
SL-2	1"-111/2	High V Liquid Injection

CHECK POINTS:

R N 0 :Discharge Temperature PT 100

R IN 1 : O'll Temperatur (Separator) PT 100

R N 2 :Suction Temperature PT 100

R N 3 :01 Temperature (Compressor) PT 100

R IN 6 : Volume Ratio Piston Position

R IN 7 : Capacity Piston Position

A IN 0 :Suction Pressure (Transmitter -1-+6 bar g)

A IN 1 : Discharge Pressure (Transmitter 0-25 bar g)

A N 2 :01 Pressure at Compressor (Transmitter D-25 bar g)

A N 4 :01 Pressure before Oil Filter (Transmitter 0-25 bar g)

IN 0 :Level Switch

IN 7 :High Disch. Pressure Switch KP7ABS (preset: 17 bar DBK/23 bar SDBK) man reset

Compressor Block B limited by hidden line (-----).