



aquaciat

LD

Cooling capacity : 35 to 270 kW

Heating capacity : 40 to 330 kW



PROPELLER
CONDENSER

Silent operation
Low speed fans
Optimal control
by microprocessor
All year round operation



USE

The new range **AQUACIAT** offers a solution to both heating and cooling applications encountered in the public, tertiary or industrial process fields.

Its remarkable acoustic characteristics, its microprocessor integral control and the large range of versions make this unit suitable to any application.

All the components are mounted on a steel frame with **large dismountable panels to ease maintenance operations.**

This line of products exists in 6 versions :

AQUACIAT LD

COOLING ALONE operation

AQUACIAT LDH

COOLING ALONE operation + hydraulic module

AQUACIAT LDC

COOLING ALONE operation + pumping unit.

AQUACIAT ILD

REVERSIBLE HEATING or COOLING operation

AQUACIAT ILDH

REVERSIBLE HEATING or COOLING operation + hydraulic module

The whole range integrates the last technological innovations and meets following expectations :

- **Silence,**
- **Respect of environment,**
- **Simplicity of installation and reliability.**

QUICK SELECTION

AQUACIAT (LOW NOISE)			100	150	200	250	300	350	400	450	500	600	750	753	900	1000	
Number of circuit(s)			1						2								
Number of compressor(s)			1		2		3			4		5		3		4	
COOLING ALONE LD / LDH / LDC	R407C	Cooling capacity (1)	kW	22.2	34.1	45.5	57.6	67.8	78.1	88.9	96.4	105.5	125.2	153.6	189.8	223.1	244.3
		Compressor power input	kW	10.45	15.35	20.6	25.3	31.1	37.5	42.6	50.5	56.5	69.4	87.8	66.7	83.3	92.85
		Pressure drop	kpa	12.5	24	29	23	31	26	23	22	23.5	26	32	33	32	37
	R22	Cooling capacity (1)	kW	24	36.3	46.9	60.9	71.3	83.5	93.2	102.5	111.2	134.4	164.5	192.5	221.7	253.4
		Compressor power input	kW	9.55	14.45	19.2	23.8	29	35.5	40	47.2	52.8	64.2	81.4	65.5	76.9	88.9
		Pressure drop	kpa	14.5	27	30	26	34	30	25	25	26	29	37	34.6	32.4	31
REVERSIBLE ILD / ILDH	R407C	Cooling capacity (1)	kW	-	-	41.6	52.8	60.8	70.6	82.8	95.3	95.4	114.9	/	177.3	204.7	220.4
		Compressor power input	kW	-	-	20.5	24.7	29.8	36.6	43.1	47.4	55.4	64.6	/	72.5	89.7	99.0
		Pressure drop	kpa	-	-	9.8	15.7	20.6	17.5	20.6	26.5	17.6	27.4	/	27.5	23.6	33.3
		Heating capacity (2)	kW	-	-	46.6	59.1	73.2	82.7	92.4	106.7	114.4	139.5	/	179.5	211.6	230
		Compressor power input	kW	-	-	17.8	23.05	26.4	31.8	34.1	38.9	43.1	52.5	/	64.8	78.6	86.9
		Pressure drop	kpa	-	-	9.8	15.7	20.6	17.5	20.6	26.5	17.6	27.4	/	27.5	23.6	33.3
	R22	Cooling capacity (1)	kW	-	-	45.6	57.1	66.2	76.8	91.2	103.8	108.3	131.1	/	168.2	193.3	213.4
		Compressor power input	kW	-	-	19.2	23.2	28.2	33.9	39.6	44.4	50.2	58.8	/	63.6	78.5	87.5
		Pressure drop	kpa	-	-	13	20	27	22	28	36	25	36	/	28	24.7	29.4
		Heating capacity (1)	kW	-	-	52.4	66	80	88.2	103.9	114.8	125	155.7	/	186.5	216.8	233.5
		Compressor power input	kW	-	-	17.9	22	26.2	31.7	34	37.9	41.9	51.4	/	62.1	74.6	82.9
		Pressure drop	kpa	-	-	13	20	27	22	28	36	25	36	/	28	24.7	29.4

(1) Cooling capacity and power input (without pump) for a +7 °C chilled water outlet and a 35 °C air inlet.

(2) Heating capacity and power input (without pump) for a +45°C hot water outlet with the same water flow as the cooling mode and a +7°C DB RH air inlet.
Exchange fouling factor : 0,000044 m²C/W

DESCRIPTION

AQUACIAT LD

■ Unit conforms to EN 60-204 - EN 378-2 norms and to following directives :

- 98 / 37 CEE

- CEM 89 / 336 CEE modified 92/31 CEE 93/68 CEE

Low voltage 73/23 CEE modified 93/68 CEE

- DESP 97 / 23 CEE -> group 2

■ Scroll hermetic compressor(s)

■ Motor cooled by suction gas

■ Internal motor protection by winding sensor

■ Mounted on resilient mounts

■ Brazed plates evaporator

■ End and internal plates made of AISI 316 stainless steel, with high performance optimized pattern.

■ Thermal insulation

■ Air cooled condenser

■ Copper pipes and mechanically bonded aluminium fins coils

■ Direct drive propeller fan(s) 500 or 750 rpm (standard wiring: 500 rpm)

■ **2 speed motor - IP 55, Class F**

■ Coil protection grille (models 100 to 750)

0)

■ Control and safety devices

■ HP safety by manual reset pressostats

■ LP safety :

- by automatic pressostats models ILD 200 to 600

- by pressure pick-up and electronic regulator (other models)

■ Water flow controller mounted

■ Condensing pressure regulation allowing an operation down to - 15°C outside :

- by automatic HP pressostats (models ILD 100 to 600)

- by pressure pick-up and electronic regulator (other models)

■ Evaporator anti-frost protection :

- by trace heating element

- by room heaters models 753 to 1000

■ Control panel

■ Main safety switch with external handle

■ Remote circuit transformer

■ Remote control and power circuits protection

■ Contactors and compressor(s) fan(s) motors protection

■ Wiring numbering

■ **Microprocessor electronic module ensuring the following main functions**

- chilled water temperature control (on evaporator return or departure) or a function of the outside temperature.

- operating parameters control

- faults diagnosis

- automatic equalization of compressors running hours

- remote management and remote survey

- **RS 485** exit for BUS control

- HP and LP pressure pick up for manometers.

AQUACIAT LDH

The basic composition of the **AQUACIAT LDH** water chillers is identical to the AQUACIAT LD

These derived units integrate a **complete hydraulic module** based on a traditional installation :

- 1 buffer tank in black sheet metal, with thermal insulation.
- 1 monocellular centrifugal hydraulic pump (single or double pump).(1)
- 1 expansion vessel
- 1 automatic air vent
- 1 safety valve
- 1 filling hole with valves
- 1 draining hole with valve
- 1 set of manometers
- Contactor(s) and protection device(s) for the hydraulic pump.
- **Hydraulic circuit antifreeze protection through electrical heaters and thermostat (all models) + tank protection by immersion heater (753 to 1000)**
- 1 strainer
- 1 balancing valve (models 100 to 750)

AQUACIAT LDC

The basic composition of the **AQUACIAT LDC** water chillers is identical to the one of the AQUACIAT LD

These derived units integrate the **pumping unit** :

- 1 monocellular centrifugal hydraulic pump (single or double pump).(1)
- 1 expansion vessel
- 1 automatic air vent
- 1 safety valve
- 1 filling hole with valves
- 1 draining hole with valve
- 1 set of manometers
- Contactor(s) and protection device(s) for the hydraulic pump.
- **Hydraulic circuit antifreeze protection**
- 1 strainer
- 1 balancing valve (models 100 to 600)

AQUACIAT serie ILD

The **AQUACIAT ILD** allows, by reversing the thermodynamic cycle, a production of chilled or hot water, depending on the season. Associated with the CIAT terminal units (fan coils, cassettes, air handling units), they offer a maximum comfort and high performances all year around.

AQUACIAT ILDH

The basic composition of **AQUACIAT** units **ILDH** is identical to the one of the AQUACIAT ILD, plus the **hydraulic module**.

IMPORTANT

Each can be equipped with brazed plates **desuperheater(s)** to permanently recover part of the heat for hot water production. This option is particularly suitable for installations operating all year around and **guarantees important energy savings**.

OPTIONS

- Antivibration equipment :
 - hydraulic flexible connections kit
 - High and low pressure gauge panel (ILD - ILDH) 200 to 600
 - Coil protection grille
 - Coil treatment :
 - Polyurethane coated fins
 - Blygold Polual treatment
 - Remote control
 - Dry contacts relay card
 - Variable speed
 - Supply voltage 230 V - 3 ph - 50 Hz
 - Brazed plates desuperheater(s) (Except LDC version)
- (1) Our pumps are designed for operation on a close water loop (low NPSH). For other applications, consult us (open water circuit, important intake height, etc).


AQUACIAT		100		150		200		250		300		350		400		450		500		600		750		753		900		1000	
		LD	LD	LD	ILD	LD	ILD	LD	ILD	LD	ILD	LD	ILD	LD	ILD	LD	ILD	LD	ILD	LD	ILD	LD	ILD	LD	ILD	LD	ILD	LD	ILD
Réf	Operation with R22	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	Operation with R407C (models Z)	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
Standard	Coil protection grille	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	Control transformer	●	●	●	-	●	-	●	-	●	-	●	-	●	-	●	-	●	-	●	-	●	-	●	-	●	-	●	-
	All year around regulator	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	Anti-frost protection	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	Water flow controller	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	Low speed fans	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	Safety switch	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	Wiring numbering	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	Set of resilient mounts	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
	Available options	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●
Available options	Hydraulic flexible connections kit	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	
	Pressure gauge panel HP - LP	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	
	Coil protection treatment	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	
	Remote control box	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	
	Potential free contacts relay card	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	
	Desuperheaters	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	
	SINGLE pump (version H/C)	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	●	
	DOUBLE pump (version H/C)	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	▲	
Variable speed	▲	▲	▲	-	▲	-	▲	-	▲	-	▲	-	▲	-	▲	-	▲	-	▲	-	▲	-	▲	-	▲	-	▲		

● Standard supply ▲ Option - Not available

OPERATING LIMITS

Chilled water production	LD - LDC - LDH
Outside ambient temperature	
°C maxi with full load	
Fans 500 rpm	+40 °C (44 °C -> 753 à 1000)
Fans 750 rpm	+44 °C
Mini °C	-15 °C
Evaporator	
ΔT mini °C	see curves below
ΔT maxi °C	
Hot water production	ILD - ILDH
Outside ambient temperature	
Maxi wet bulb temp °C	+15 °C
Mini wet bulb temp °C	-10 °C
Condenser	
Hot water outlet temperature °C	+50 °C
ΔT mini °C	5 °C
ΔT maxi °C	10 °C


LD - LDC - LDH 100Z to 1000Z

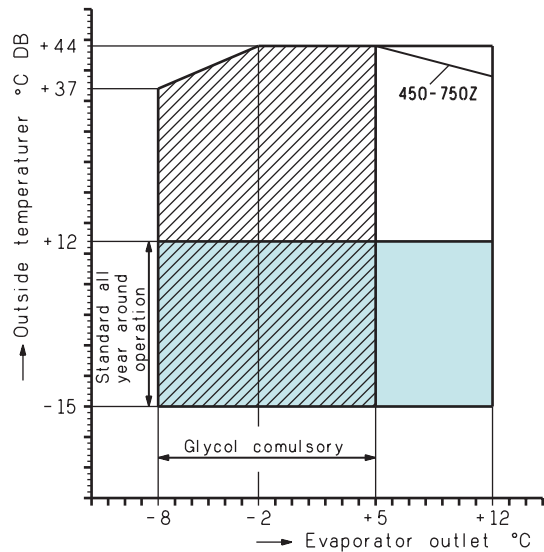

Evaporator

The curves below represent the minimum and maximum temperature differences admissible on the chilled or glycolated water, as a function of the outlet temperature.


LD - LDC - LDH 100 to 1000

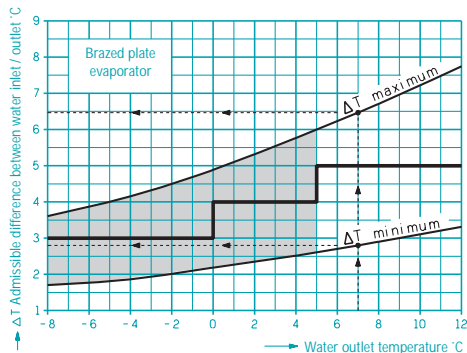

— Performance tables calculations ΔT
 shaded area glycol water



Example : for a water outlet : + 7 °C
 ΔT minimum : 2,8 °C / water temp : 9,8 / 7 °C
 ΔT maximum : 6,5 °C / water temp : 13,5 / 7 °C
 For temperature differences not included between the two curves, consult us.

ILD - ILDH 200 to 1000

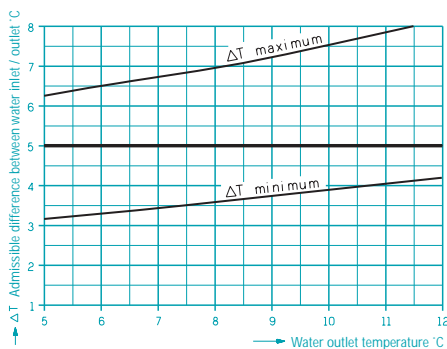

— Performance tables calculations ΔT

ILD - ILDH 100Z to 1000Z

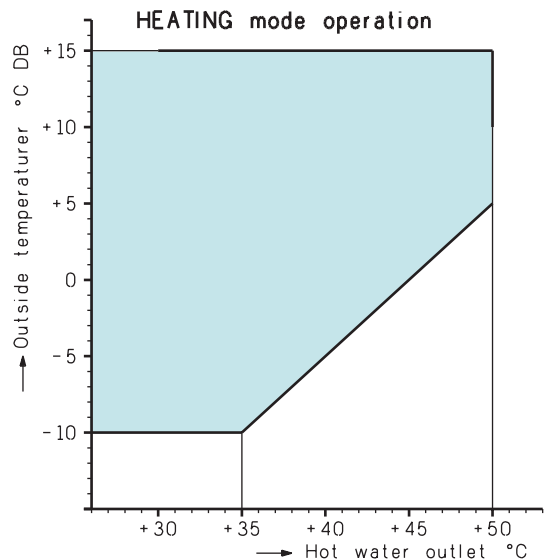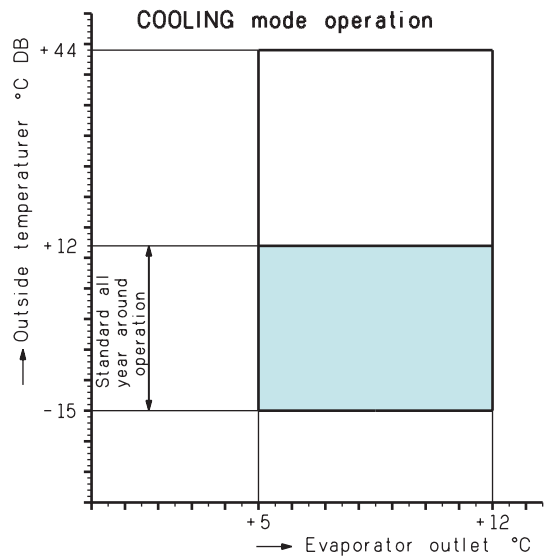

GLYCOL WATER COEFFICIENT

- 30 % concentration by glycol weight
- Freezing point of the solution : - 17.5 °C

CORRECTION		POSITIVE CONDITIONS		NEGATIVE CONDITIONS	
		K	Calculation mode	K	Calculation mode
Evaporator	Cooling capacity	0,98	$P_{fc} = P_f \times 0,98$	1,00	See selection table
	Chilled water flow	1,05	$Q_c = P_{fc} \times 0,86 \times 1,05$	1,10	$Q_c = P_{fc} \times 0,86 \times 1,10$
	Water pressure	1,15	$\Delta P_c = \Delta P \times 1,15$	1,30	$\Delta P_c = \Delta P \times 1,30$
	Average temp.	12 / 7 ° C		See table	
Condenser	Cooling capacity	0,97	$P_{fc} = P_f \times 0,97$		
	Chilled water flow	1,05	$Q_c = (P_{fc} + P_a) \times 0,86 \times 1,10$		
	Water pressure	1,10	$\Delta P_c = \Delta P \times 1,10$		
	Average temp.	35 / 40 ° C			

K : Correction coefficient
Values written in the brochure :
P_f : cooling capacity as per selection table
P_a : compressors power input as per selection tables
ΔP : water pressure drop as per curves, for the corresponding corrected flow value (Q_c)

Values corrected as per above calculations :
P_{fc} : corrected cooling capacity
Q_c : corrected flow, chilled or hot water
ΔP_c : corrected water pressure drop, evaporator or condenser

UNITS CONVERSION FORMULA

USRT	kW x 0,2846
Btu/h	kW x 3414
kcal/h	kW x 860
Frig/h	kcal/h
Cheval vapeur (CH)	kW x 1,36
Horsepower (HP)	kW x 1,341
kPa	bar x 100
bar	mCE x 0,0981
kg/cm ²	bar x 1,0197
Livre/Pouce ² (lbf/in ²)	bar x 14,504
Pouce (in)	mm x 0,0394
Pied (ft)	mm x 0,0032808
Livre (lb)	kg x 2,205
Pied ³ /mn (cfm)	m ³ /h x 0,5885
Gallons US	m ³ x 264,2
Gallons UK	m ³ x 220
Degré Fahrenheit (°F)	(°C x 9/5) + 32

PROPELLER
CONDENSER

MINIMUM WATER VOLUME

- LD - LDC - LDH / ILD - ILDH

The Connect control is equipped with an anticipation logic allowing high flexibility in adjusting the set points according to the parameters drifting, in particular for low water volume hydraulic installations.

An adapted management of the compressors operating periods avoids therefore the start of anti-short cycle functions, and in most cases, the requirement of a buffer tank.

Models LD - ILD - LDC	100	150	200	250	300	350	400	450	500	600	750	753	900	1000
Minimum volume Of installation	112	181	110	112	174	121	174	167	106	164	161	327	257	322

Remark :

Industrial processes which require high stability of water temperatures or installations with high thermal load variation can privilege the use of LDH-ILDH models equipped with a buffer tank.

COOLING CAPACITY



STANDARD version

PROPELLER
CONDENSER

AQUACIAT LD - LDC - LDH		Evaporator water outlet temperature in °C	INLET AIR TEMPERATURE AT THE CONDENSER °C													
			28		32		36		40		44					
			Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW				
100Z	Fans 750 rpm	Glycol water	-8	13,4	6,9	12,6	7,5	11,9	8,2							
			-4	15,9	7,1	15,0	7,8	14,2	8,5	13,4	9,3					
			2	20,3	7,5	19,3	8,2	18,3	8,9	17,2	9,8	16,0	10,7			
		Pure water	5	23,9	7,8	22,6	8,5	21,4	9,3	20,2	10,2	18,8	11,1			
			7	25,5	7,9	24,3	8,6	23,0	9,4	21,8	10,3	20,2	11,3			
			12	30,5	8,2	28,9	9,0	27,4	9,8	25,8	10,7	24,2	11,7			
	150Z	Fans 750 rpm	Glycol water	-8	20,7	10,0	19,7	10,9	18,7	11,9						
				-4	24,9	10,4	23,6	11,3	22,6	12,3	21,4	13,4				
				2	31,8	11,0	30,4	11,9	28,9	12,9	27,2	14,1	25,9	15,3		
			Pure water	5	36,6	11,4	35,3	12,4	33,6	13,4	31,9	14,6	30,1	15,8		
				7	39,6	11,7	37,9	12,6	36,2	13,7	34,1	14,8	32,3	16,1		
				12	46,7	12,3	44,8	13,3	42,6	14,4	40,4	15,6	38,1	16,8		
200Z	Fans 750 rpm	Glycol water	-8	26,8	13,6	25,7	14,8	24,3	16,2							
			-4	32,2	14,0	30,9	15,3	29,0	16,7	27,5	18,3					
			2	41,7	14,8	39,8	16,1	37,7	17,5	35,6	19,1	33,1	20,9			
		Pure water	5	48,2	15,3	46,3	16,7	44,0	18,2	41,3	19,8	39,0	21,6			
			7	52,1	15,6	49,5	17,0	47,1	18,5	44,6	20,1	41,8	21,9			
			12	61,5	16,4	58,7	17,8	55,9	19,4	52,4	21,0	49,7	22,9			
250Z	Fans 750 rpm	Glycol water	-8	34,0	16,8	32,8	18,3	30,8	19,9							
			-4	40,8	17,3	39,3	18,9	36,9	20,5	35,2	22,4					
			2	52,2	18,2	50,4	19,8	47,9	21,6	45,3	23,5	42,6	25,6			
		Pure water	5	60,6	18,9	58,6	20,6	55,8	22,3	52,3	24,3	49,7	26,4			
			7	65,8	19,3	62,7	20,9	60,0	22,8	56,8	24,7	53,1	26,8			
			12	78,3	20,3	74,3	22,0	70,7	23,8	67,0	25,9	63,3	28,1			
300Z	Fans 750 rpm	Glycol water	-8	41,2	20,2	39,4	21,9	37,4	23,9							
			-4	49,1	20,9	46,9	22,8	44,5	24,7	42,6	27,0					
			2	63,3	22,2	60,0	24,0	57,5	26,1	54,5	28,4	51,4	30,8			
		Pure water	5	72,9	23,0	70,3	25,0	67,0	27,1	63,5	29,4	59,8	31,9			
			7	78,4	23,5	75,0	25,4	71,5	27,8	68,2	30,0	64,1	32,4			
			12	93,0	24,8	88,9	26,9	84,7	29,1	80,2	31,4	75,8	34,0			
350Z	Fans 750 rpm	Glycol water	-8	47,2	23,9	45,2	26,1	42,7	28,4							
			-4	56,5	24,7	54,2	27,0	51,5	29,4	48,3	32,0					
			2	71,9	26,2	69,7	28,6	65,8	31,0	62,4	33,8	58,6	36,7			
		Pure water	5	84,2	27,4	81,0	29,8	76,7	32,3	72,1	35,0	68,3	38,1			
			7	91,1	28,1	86,3	30,3	82,0	32,9	77,8	35,8	73,1	38,8			
			12	105,7	29,8	101,8	32,1	97,2	34,8	92,2	37,7	87,0	40,8			
400Z	Fans 750 rpm	Glycol water	-8	54,5	27,1	52,2	29,5	49,4	32,1							
			-4	64,7	28,0	62,2	30,5	59,2	33,2	56,2	36,2					
			2	82,2	29,6	79,0	32,2	75,2	35,1	71,6	38,1	67,5	41,4			
		Pure water	5	96,6	30,9	92,6	33,6	88,2	36,5	83,4	39,6	78,5	42,9			
			7	103,9	31,6	99,4	34,3	94,5	37,3	89,4	40,3	84,5	43,7			
			12	121,6	33,4	116,8	36,2	111,5	39,2	105,8	42,5	99,8	46,0			
450Z	Fans 750 rpm	Glycol water	-8	60,7	31,8	58,1	34,6	54,4	37,6							
			-4	72,6	33,1	69,1	36,0	65,3	39,1	61,5	42,4					
			2	90,7	35,2	87,0	38,2	82,8	41,6	78,3	45,0	73,3	48,7			
		Pure water	5	106,0	37,1	101,0	40,2	96,2	43,5	90,8	47,1	85,6	50,9			
			7	113,5	38,0	108,3	41,2	102,9	44,5	97,3	48,1	91,5	52,0			
			12	133,0	40,4	127,1	43,8	121,0	47,3	114,3	51,0					

Pf : Cooling capacity valid for a ΔT according to operating limits.
Inlet / outlet difference, as per curve page 4
Pa : Compressor power input

Zone when glycol water must be used.
Calculation fouling 0,00005 m² °C/W

COOLING CAPACITY



STANDARD version



R407C	AQUACIAT LD - LDC - LDH		Evaporator water outlet temperature in °C	INLET AIR TEMPERATURE AT THE CONDENSER °C											
				28		32		36		40		44			
				Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW		
500 Z	Fans 750 rpm	Glycol water	-8	66.8	35.1	63.5	38.1	60.0	41.5						
			-4	79.7	36.5	76.5	39.8	72.4	43.3	67.8	47.1				
			2	101.8	39.1	97.3	42.4	92.4	46.0	87.0	50.0	81.1	54.1		
		Pure water	5	117.6	41.0	112.3	44.4	106.8	48.2	100.7	52.2	94.8	56.5		
			7	125.9	42.0	120.0	45.5	113.8	49.2	107.6	53.3	101.1	57.6		
			12	148.7	44.9	141.2	48.5	133.9	52.4	126.6	56.5				
600 Z	Fans 750 rpm	Glycol water	-8	80.1	43.6	75.1	47.3	71.8	51.7						
			-4	95.1	45.4	90.4	49.3	85.6	53.7	80.4	58.3				
			2	120.2	48.4	114.5	52.6	108.7	57.1	102.0	61.9	95.6	67.1		
		Pure water	5	138.9	50.7	132.2	55.0	125.6	59.7	118.9	64.8	110.8	69.9		
			7	148.4	51.9	141.3	56.3	134.3	61.0	126.3	66.0				
			12	174.7	55.4	166.4	60.0	157.8	64.8	148.5	69.9				
750 Z	Fans 750 rpm	Glycol water	-8	100.5	54.5	96.0	58.2	90.0	63.5						
			-4	117.8	56.3	112.0	61.2	106.2	66.5	100.0	72.3				
			2	151.1	60.5	143.4	65.5	135.5	71.0	127.4	77.0	119.2	83.3		
		Pure water	5	173.1	63.3	164.5	68.5	155.9	74.2	147.2	80.4	138.1	86.9		
			7	184.6	64.9	176.1	70.2	167.0	76.0	157.7	82.3				
			12	217.6	69.4	206.9	75.0	196.2	81.0	185.4	87.3				
753 Z	Fans 750 rpm	Glycol water	-8	109,70	47,58	104,50	51,50	99,90	55,80	95,03	60,34				
			-4	129,20	49,20	124,10	53,40	118,60	57,90	113,20	62,64	107,40	67,68		
			2	167,00	52,54	161,20	57,07	153,10	61,88	146,10	66,71	139,10	72,10		
		Pure water	5	194,10	55,00	186,50	59,71	178,20	64,20	170,00	69,65	160,80	75,03		
			7	208,80	56,38	199,60	61,03	190,60	65,86	181,40	71,04	172,20	76,56		
			12	245,40	59,96	236,00	64,97	225,40	69,90	214,70	75,26	203,10	80,78		
900 Z	Fans 750 rpm	Glycol water	-8	128,90	59,06	123,10	63,85	118,10	69,20	111,80	74,90	105,60	81,01		
			-4	153,00	61,18	146,50	66,20	139,20	71,60	133,10	77,52	125,20	83,78		
			2	199,10	65,60	190,30	70,80	180,80	76,64	172,40	82,66	163,20	89,27		
		Pure water	5	230,00	68,70	220,80	74,20	210,30	80,06	199,70	86,40	189,50	93,30		
			7	246,80	70,45	235,80	75,94	225,60	82,02	214,00	88,38	202,80	95,32		
			12	291,00	75,20	278,40	81,05	265,40	87,24	252,30	93,90	239,10	101,00		
1000 Z	Fans 750 rpm	Glycol water	-8	143,10	64,50	137,60	69,90	131,50	75,70	124,40	81,80	118,30	88,50		
			-4	169,20	67,00	162,30	72,70	155,80	78,80	147,00	85,00	139,00	91,80		
			2	219,10	72,60	209,60	78,60	199,70	85,14	190,90	91,75	180,60	98,90		
		Pure water	5	250,90	75,90	241,20	82,20	230,20	88,80	218,90	95,80	206,50	113,00		
			7	269,00	78,00	257,40	84,30	245,40	90,90	233,50	98,00	221,30	105,40		
			12	315,90	83,60	302,40	90,20	288,40	97,00	274,90	104,40	259,80	111,90		

PROPELLER
CONDENSER

Pf : Cooling capacity valid for a ΔT according to operating limits.
Inlet / outlet difference, as per curve page 4
Pa : Compressor power input

Zone when glycol water must be used.
Calculation fouling 0,00005 m² °C/W

NOTES

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

COOLING CAPACITY



LOW NOISE version

PROPELLER
CONDENSER

AQUACIAT LD - LDC - LDH		Evaporator water outlet temperature in °C	INLET AIR TEMPERATURE AT THE CONDENSER °C								
			28		32		36		40		
			Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	
R407C	100Z	Glycol water	-8	13,1	7,2	12,3	7,8				
			-4	15,4	7,5	14,6	8,1	13,7	8,9		
			2	19,6	7,9	18,6	8,7	17,6	9,5	16,4	10,4
		Pure water	5	23,0	8,3	21,7	9,1	20,5	9,9	19,1	10,8
			7	24,4	8,5	23,2	9,3	21,9	10,1	20,5	11,1
			12	28,9	9,0	27,6	9,8	25,9	10,7	24,3	11,6
	150Z	Glycol water	-8	20,1	10,6	19,1	11,5				
			-4	24,0	11,1	22,9	12,1	21,5	13,1	20,5	14,2
			2	30,3	11,9	28,9	12,9	27,4	14,0	26,0	15,2
		Pure water	5	35,0	12,6	33,1	13,6	31,7	14,7	30,0	15,9
			7	37,1	12,9	35,4	13,9	33,7	15,1	31,8	16,3
			12	43,6	13,8	41,6	14,9	39,3	16,2	37,5	17,4
	200Z	Glycol water	-8	26,1	14,1	25,1	15,4	23,6	16,9		
			-4	31,6	14,7	30,0	16,0	28,4	17,5	26,6	19,1
			2	40,0	15,6	38,0	17,0	36,2	18,6	33,8	20,3
		Pure water	5	46,4	16,4	44,5	17,9	42,0	19,5	39,6	21,2
			7	49,9	16,8	47,4	18,3	44,9	19,9	42,2	21,6
			12	58,7	17,9	55,8	19,4	52,8	21,1	49,8	22,9
	250Z	Glycol water	-8	33,3	17,5	32,0	19,2	30,2	20,9		
			-4	40,0	18,3	38,0	19,9	35,7	21,7	33,5	23,6
			2	50,3	19,5	48,4	21,3	45,8	23,1	43,3	25,1
		Pure water	5	58,5	20,5	55,9	22,3	52,8	24,1	50,1	26,2
			7	62,5	21,0	59,9	22,8	56,8	24,7	53,5	26,8
			12	73,6	22,4	70,5	24,3	66,5	26,2	62,8	28,4
300Z	Glycol water	-8	40,1	21,3	38,1	23,1					
		-4	47,8	22,4	45,1	24,3	43,2	26,5			
		2	60,4	24,1	57,5	26,2	54,2	28,3	51,5	30,7	
	Pure water	5	69,1	25,4	66,3	27,6	62,9	29,8	59,4	32,2	
		7	74,4	26,2	70,9	28,3	66,8	30,5	63,2	32,9	
		12	86,9	28,1	82,5	30,2	78,3	32,6	74,0	35,1	
350Z	Glycol water	-8	45,8	25,2	43,8	27,5					
		-4	55,1	26,5	52,0	28,8	49,2	31,3	46,4	36,0	
		2	69,6	28,6	66,2	31,0	62,6	33,7	59,0	36,5	
	Pure water	5	79,6	30,1	75,9	32,6	72,0	35,3	67,8	38,3	
		7	85,4	31,0	81,2	33,7	77,1	36,3	72,5	39,3	
		12	99,0	33,2	94,3	36,1	89,7	38,8			
400Z	Glycol water	-8	52,9	28,9	50,6	31,4					
		-4	62,6	30,2	59,4	32,8	56,4	35,7			
		2	79,0	32,7	75,3	35,4	71,4	38,4	67,6	41,6	
	Pure water	5	91,0	34,6	86,7	37,4	82,1	40,4	77,4	43,7	
		7	97,3	35,6	92,6	38,5	87,7	41,6	82,7	44,9	
		12	113,0	38,4	107,8	41,4	102,2	44,6			
450Z	Glycol water	-8	58,1	33,9	55,4	36,8					
		-4	68,9	35,7	65,6	38,7	61,9	41,9	58,4	45,5	
		2	85,5	38,6	81,5	41,9	77,6	45,4	73,2	49,1	
	Pure water	5	99,6	41,4	94,2	44,6	89,0	48,1	84,2	51,9	
		7	105,6	42,8	100,4	46,0	95,1	49,6			
		12	122,7	46,2	116,4	49,7	110,2	53,3			

Pf : Cooling capacity valid for a ΔT according to operating limits.
 Inlet / outlet difference, as per curve page 4
 Pa : Compressor power input

Zone when glycol water must be used.
 Calculation fouling 0,00005 m² °C/W

COOLING CAPACITY



LOW NOISE version



AQUACIAT LD - LDC - LDH		Evaporator water outlet temperature in °C	INLET AIR TEMPERATURE AT THE CONDENSER °C								
			28		32		36		40		
			Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	
R407C	500 Z	Glycol water	-8	63.9	37.7	61.2	41.0				
			-4	75.8	39.9	72.4	43.3	68.0	46.9		
			2	94.1	43.4	90.0	47.0	85.2	51.0	80.1	55.1
		Pure water	5	108.5	46.3	103.8	50.2	98.1	54.2	92.3	58.3
			7	116.0	47.9	110.0	51.7	104.0	55.7		
			12	134.4	52.1	127.6	56.0				
	600 Z	Glycol water	-8	76.9	46.6	72.7	50.7				
			-4	90.2	49.0	85.5	53.2	80.2	57.6		
			2	113.4	53.5	107.6	57.9	100.7	62.5	95.0	67.7
		Pure water	5	128.7	56.5	122.7	61.0	115.8	65.9	108.7	71.0
			7	137.9	58.3	130.6	62.9	123.4	67.9		
			12	160.5	63.3	151.9	68.1				
700 Z	Glycol water	-8	94.5	58.3	89.7	63.4					
		-4	111.4	61.8	105.7	67.0	99.6	72.6			
		2	139.3	68.0	132.3	73.3	124.8	79.2	117.2	85.4	
	Pure water	5	159.4	72.4	150.9	78.0	142.3	84.0			
		7	169.1	74.7	160.2	80.4	151.4	86.6			
		12	195.2	81.2	185.5	87.5					
753 Z	Glycol water	-8	108,50	48,20	103,60	52,28	99,67	56,67	94,24	61,20	
		-4	128,10	50,15	122,90	54,40	117,90	58,99	111,50	63,63	
		2	165,10	53,98	158,40	58,49	151,60	63,30	144,40	68,36	
	Pure water	5	191,30	56,80	183,40	61,40	175,10	66,30	166,20	71,42	
		7	204,30	58,20	195,80	62,90	186,80	67,84	178,50	73,14	
		12	240,80	62,34	230,40	67,17	220,60	72,26	209,10	77,90	
900 Z	Glycol water	-8	127,40	60,02	123,10	63,86	117,90	69,17	111,90	74,84	
		-4	151,30	62,50	145,10	67,70	138,60	73,23	130,50	79,02	
		2	195,90	67,50	187,20	72,90	178,70	78,77	169,00	84,88	
	Pure water	5	225,20	71,20	216,10	76,70	205,90	82,69	195,20	89,06	
		7	241,90	73,09	231,20	78,76	220,50	84,90	209,00	91,32	
		12	283,70	78,46	271,20	84,40	258,60	90,76	245,50	97,60	
1000 Z	Glycol water	-8	142,60	62,86	135,46	67,70	129,46	73,02	122,42	78,46	
		-4	166,90	65,90	160,40	71,00	152,50	76,46	144,86	82,42	
		2	214,00	71,60	204,60	77,38	195,00	83,26	184,60	89,30	
	Pure water	5	245,60	75,98	236,00	81,92	224,80	88,20	213,40	94,48	
		7	263,20	78,44	251,80	84,24	240,00	90,50	228,00	96,94	
		12	307,80	84,62	294,80	90,60	280,60	97,20	266,60	104,54	

PROPELLER
CONDENSER

Pf : Cooling capacity valid for a ΔT according to operating limits.
 Inlet / outlet difference, as per curve page 4
 Pa : Compressor power input

Zone when glycol water must be used.
 Calculation fouling 0,00005 m² °C/W

NOTES

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

Reversible AQUACIAT ILD - ILDH

The reversibility on one single unit offers an appreciable economical advantage :

■ **In winter** : thanks to their high coefficient of performance (COP), the reversible AQUACIAT units offer a low and controlled heating cost. Designed for extreme conditions, the AQUACIAT can operate down to - 15 °C outside temperature. The reverse cycle represents substantial savings, up to 50 % compared to a traditional heating device.

■ **In summer** : the same unit allows cooling at a lower cost.



AQUACIAT ILDH

Monobloc design, tested in factory and fitted with all the accessories required by an hydraulic circuit (buffer tank, expansion vessel, circulation pump...), the installation of reversible AQUACIAT, ILDH with hydraulic module heater is simple, quick and at a low cost.

These compact units save a lot of space in the plant room (pumps, tanks integrated).

COOLING CAPACITIES

STANDARD version



R407C	AQUACIAT ILD - ILDH		Evaporator water outlet temperature in °C	INLET AIR TEMPERATURE AT THE CONDENSER IN °C										
				28		32		36		40		44		
				Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	
200 Z	Fans 750 rpm	Pure water	5	44.0	15.2	42.0	16.6	39.8	18.2	37.7	19.9	35.3	21.8	
			6	45.3	15.3	43.5	16.7	41.4	18.3	39.1	20.0	36.7	21.9	
			7	46.9	15.4	44.8	16.9	42.8	18.4	40.4	20.2	37.9	22.0	
			8	48.4	15.5	46.3	17.0	44.2	18.5	41.9	20.3	39.2	22.2	
			10	51.7	15.8	49.4	17.3	47.2	18.8	44.7	20.6	42.0	22.5	
			12	55.0	16.0	52.8	17.5	50.3	19.1	47.6	20.9	44.8	22.8	
	250 Z	Fans 750 rpm	Pure water	5	55.8	18.5	52.9	20.1	51.0	21.9	48.5	23.9	45.4	25.9
				6	57.9	18.7	55.4	20.3	52.9	22.1	50.3	24.1	47.5	26.2
				7	60.0	18.8	57.5	20.5	54.7	22.3	51.6	24.2	49.2	26.4
				8	62.1	19.0	59.5	20.6	56.8	22.5	53.5	24.4	51.0	26.6
				10	66.4	19.3	63.0	21.0	60.7	22.8	57.4	24.8	54.1	27.0
				12	70.2	19.7	68.4	21.5	65.8	23.4	61.2	25.2	57.9	27.4
300 Z	Fans 750 rpm	Pure water	5	64.3	22.1	62.0	24.0	59.1	26.1	56.1	28.4	54.1	31.2	
			6	66.6	22.3	64.2	24.2	61.4	26.4	58.3	28.7	55.3	31.2	
			7	69.2	22.5	66.5	24.5	63.5	26.6	60.2	28.9	57.3	31.4	
			8	71.8	22.7	68.8	24.7	65.6	26.8	62.3	29.1	59.3	31.7	
			10	76.3	23.1	73.2	25.1	70.0	27.2	66.6	29.6	63.2	32.1	
			12	81.4	23.5	78.3	25.5	74.8	27.7	71.1	30.1	67.4	32.6	
350 Z	Fans 750 rpm	Pure water	5	75.2	27.1	71.7	29.7	68.4	32.5	64.7	35.2	60.9	38.5	
			6	77.8	27.3	74.3	29.8	70.8	32.5	65.1	35.5	63.0	38.8	
			7	80.4	27.5	76.9	30.0	73.3	32.8	69.3	35.8	65.2	39.1	
			8	83.1	27.8	79.5	30.3	75.8	33.1	71.8	36.1	67.4	39.4	
			10	84.5	31.0	80.6	33.7	76.3	36.7	76.4	36.6	72.1	40.0	
			12	94.0	28.7	90.3	31.4	85.8	34.2	81.5	37.3	76.8	40.6	
400 Z	Fans 750 rpm	Pure water	5	89.2	31.7	85.3	34.5	81.5	37.5	77.3	40.7	72.3	44.5	
			6	94.1	32.3	87.9	34.8	84.9	38.0	80.0	41.2	75.5	44.7	
			7	95.2	32.3	91.1	35.1	86.9	38.2	82.8	41.6	78.3	45.1	
			8	97.8	32.6	94.1	35.5	89.6	38.5	85.3	41.9	80.5	45.5	
			10	104.2	33.3	100.2	36.2	95.4	39.3	90.7	42.7	85.7	46.3	
			12	111.0	34.0	106.3	36.9	101.4	40.1	96.5	43.5	91.2	47.4	
450 Z	Fans 750 rpm	Pure water	5	102.0	34.9	97.7	37.9	93.8	41.3	89.2	44.9	84.1	48.7	
			6	105.3	35.2	101.2	38.3	96.6	41.6	92.2	45.3	87.1	49.2	
			7	109.1	35.6	104.2	38.6	100.0	42.0	95.3	45.7	89.9	49.6	
			8	112.6	35.9	107.9	39.0	102.7	42.3	95.5	45.6	92.9	50.0	
			10	119.8	36.6	115.1	39.8	109.8	43.2	104.6	46.9	99.1	50.9	
			12	127.0	37.3	121.9	40.5	116.6	44.0	111.3	47.8	105.2	51.8	
500 Z	Fans 750 rpm	Pure water	5	104.7	40.9	99.6	44.6	94.4	48.5	88.8	52.8	83.2	57.5	
			6	108.1	41.3	102.9	45.0	97.7	49.0	92.0	53.4	86.1	58.0	
			7	111.7	41.7	106.6	45.5	100.8	49.5	95.1	53.8	89.0	58.6	
			8	113.3	41.9	109.8	45.9	104.2	50.0	98.3	54.4	95.3	59.5	
			10	123.0	43.1	117.1	46.9	111.1	51.0	104.8	55.5			
			12	130.9	44.0	124.5	47.9	118.1	52.0	111.4	56.5			
600 Z	Fans 750 rpm	Pure water	5	125.4	47.4	119.7	51.5	113.7	56.0	107.3	60.9	100.8	66.2	
			6	129.8	47.9	123.8	52.0	117.9	56.8	109.9	61.2	104.5	66.7	
			7	134.1	48.3	127.8	52.5	121.6	57.1	114.9	62.0	108.0	67.3	
			8	139.5	48.9	132.1	53.0	125.8	57.6	118.9	62.6	111.8	67.9	
			10	147.6	49.8	140.9	54.0	134.1	58.7	127.9	63.7	119.3	69.1	
			12	157.3	50.8	150.1	55.1	142.5	59.8	135.1	64.9	127.1	70.3	

PROPELLER
CONDENSER

Pf : Cooling capacity valid a ΔT according to operating limits.
 Inl_{ite} / outlet difference, as per curve page 4
 Pa : Compressor power input

Calculation fouling 0,00005 m² °C/W

COOLING CAPACITIES



STANDARD version



PROPELLER
CONDENSER

AQUACIAT ILD - ILDH		Evaporator water outlet temperature in °C	INLET AIR TEMPERATURE AT THE CONDENSER IN °C										
			28		32		36		40		44		
			Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	
R407C	753 Z	Fans 750 rpm Pure water	5	180,9	56,9	173,6	61,7	166,2	66,7	158,3	72,2	150,1	77,9
			6	187,1	57,5	179,9	62,4	171,9	67,5	163,9	73,0	155,5	78,8
			7	193,3	58,2	186,2	63,1	177,6	68,2	169,6	73,7	160,9	79,6
			8	200,5	59,0	192,9	63,9	184,1	69,1	175,7	74,6	166,7	80,5
			10	214,9	60,5	206,3	65,5	197,2	70,8	188,0	76,4	178,3	82,4
			12	229,3	62,0	219,7	67,1	210,3	72,5	200,3	78,2	190,0	84,3
	900 Z	Fans 750 rpm Pure water	5	210,2	71,6	200,9	77,4	191,9	83,5	182,4	90,3	172,9	97,6
			6	217,8	72,6	208,5	78,4	198,8	84,6	189,2	91,4	179,2	98,8
			7	225,5	73,5	216,1	79,3	205,7	85,6	196,0	92,5	185,5	99,9
			8	233,7	74,5	223,9	80,4	213,3	86,7	203,0	93,7	189,3	100,6
			10	250,2	76,6	239,5	82,5	228,4	89,0	217,0	96,0	196,8	101,9
			12	266,7	78,7	255,0	84,6	243,5	91,3	231,1	98,3	204,4	103,2
1000 Z	Fans 750 rpm Pure water	5	227,1	78,6	217,2	85,0	207,4	91,8	197,3	99,1	186,9	106,9	
		6	236,0	79,8	225,1	86,1	214,9	92,9	204,2	100,3	193,6	108,2	
		7	245,0	81,0	233,1	87,2	222,4	94,1	211,2	101,5	200,3	109,5	
		8	253,5	82,0	241,4	88,3	230,3	95,4	218,7	102,8	207,4	110,9	
		10	270,5	84,0	258,0	90,7	246,0	97,8	233,8	105,4	221,5	113,6	
		12	287,5	86,1	274,5	93,1	261,7	100,3	248,9	108,0	235,5	116,3	

Pf : Cooling capacity valid a ΔT according to operating limits.
 Inlfe / outlet difference, as per curve page 4
 Pa : Compressor power input

Calculation fouling 0,00005 m² °C/W

NOTES

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

.....

COOLING CAPACITIES



LOW NOISE version



R407C	AQUACIAT ILD - ILDH		Evaporator water outlet temperature in °C	INLET AIR TEMPERATURE AT THE CONDENSER IN °C								
				28		32		36		40		
				Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	Pf kW	Pa kW	
200 Z	Fans 500 rpm	Pure water	5	42.6	16.3	40.5	17.7	38.4	19.4	36.1	21.2	
			6	43.8	16.4	41.7	17.9	39.6	19.6	37.3	21.4	
			7	45.4	16.6	43.2	18.1	41.0	19.8	38.6	21.6	
			8	46.7	16.7	44.6	18.2	42.4	19.9	39.9	21.8	
			10	49.8	17.0	47.6	18.6	45.0	20.3	42.5	22.2	
			12	52.8	17.4	50.6	19.0	48.0	20.7	45.2	22.6	
	250 Z	Fans 500 rpm	Pure water	5	53.9	19.9	51.5	21.7	48.9	23.6	46.3	25.7
				6	55.6	20.2	53.0	21.9	50.5	23.8	47.8	25.9
				7	57.2	20.4	54.7	22.1	52.2	24.1	49.5	26.1
				8	59.0	20.6	56.6	22.3	53.7	24.4	50.9	26.4
				10	63.4	21.1	60.4	22.9	57.4	24.9	54.4	27.0
				12	66.9	21.5	63.9	23.3	60.8	25.4	57.6	27.6
300 Z	Fans 500 rpm	Pure water	5	63.1	24.3	58.7	26.2	56.4	28.5	54.4	31.1	
			6	65.1	24.6	62.3	26.7	59.3	29.0	56.2	31.4	
			7	65.9	24.9	63.0	27.0	60.0	29.3	56.8	31.7	
			8	68.1	25.2	66.0	27.5	63.0	29.8	59.7	32.3	
			10	73.6	25.8	70.5	28.0	67.1	30.3	63.8	32.8	
			12	78.1	26.4	75.1	28.7	71.1	30.9	67.5	33.5	
350 Z	Fans 500 rpm	Pure water	5	72.1	29.3	68.8	32.0	65.2	34.9	61.4	38.1	
			6	74.5	29.6	71.1	32.3	67.4	35.2	63.5	38.4	
			7	77.0	29.9	73.3	32.6	69.7	35.6	65.6	38.8	
			8	79.4	30.3	75.8	33.0	72.0	36.0	67.7	39.2	
			10	84.4	30.9	80.4	33.7	76.4	36.7	72.1	40.0	
			12	89.6	31.7	85.6	34.5	81.1	37.5	76.4	40.8	
400 Z	Fans 500 rpm	Pure water	5	84.9	35.0	81.1	38.0	76.7	41.1	72.5	44.6	
			6	87.3	35.3	83.4	38.4	79.3	41.7	75.0	45.2	
			7	90.0	35.8	86.3	38.9	81.8	42.2	77.3	45.7	
			8	92.5	36.5	88.6	39.4	84.3	42.7	79.6	46.2	
			10	98.5	37.2	94.0	40.4	89.4	43.8	84.4	47.3	
			12	104.3	38.2	99.5	41.4	94.6	44.9			
450 Z	Fans 500 rpm	Pure water	5	97.1	38.7	93.0	41.9	88.4	45.5	83.5	49.2	
			6	100.5	39.2	95.8	42.4	91.2	46.0	86.2	49.8	
			7	103.3	39.6	98.8	42.9	94.0	46.6	88.9	50.4	
			8	106.9	40.1	102.0	43.5	96.8	47.1	91.6	50.9	
			10	113.1	41.1	107.9	44.5	102.7	48.2	97.1	52.2	
			12	119.5	42.1	114.5	45.7	108.8	49.4	102.9	53.4	
500 Z	Fans 500 rpm	Pure water	5	98.7	45.4	93.5	49.2	88.2	53.4	82.7	57.9	
			6	101.9	45.9	96.6	49.9	91.0	54.1	85.3	58.6	
			7	105.1	46.5	99.6	50.5	93.9	54.7	88.1	59.3	
			8	108.2	47.1	102.8	51.2	96.8	55.4			
			10	115.0	48.5	109.0	52.4	98.3	55.8			
			12	121.7	49.6	115.4	53.8	102	56.6			
600 Z	Fans 500 rpm	Pure water	5	118.3	52.6	112.4	57.0	106.3	61.8	100.0	66.9	
			6	122.1	53.2	115.6	58.1	109.8	62.5	103.2	67.7	
			7	126.1	53.9	119.8	58.4	113.3	63.2	106.6	68.4	
			8	130.0	54.6	123.5	59.1	116.9	64.0	110.0	69.3	
			10	137.7	56.1	131.2	60.6	124.2	65.6	116.9	70.9	
			12	146.2	57.5	138.9	62.2	131.6	67.2	124.0	72.6	

PROPELLER
CONDENSER

Pf : Cooling capacity valid a ΔT according to operating limits.
 Inlnt / outlet difference, as per curve page 4
 Pa : Compressor power input

Calculation fouling 0,00005 m² °C/W

HEATING CAPACITY



STANDARD version

AQUACIAT ILD - ILDH	External air temperature in°C WB (1)	CONDENSER WATER OUTLET TEMPERATURE IN °C										
		30		35		40		45		50		
		Pc kW	Pa kW	Pc kW	Pa kW	Pc kW	Pa kW	Pc kW	Pa kW	Pc kW	Pa kW	
200 Z	Fans 750 rpm	-10	30.8	11.7	31.0	13.1						
		-5	35.5	11.8	35.6	13.2	35.8	14.8				
		0	40.9	11.9	40.6	13.3	40.7	14.8	40.8	16.6	41.0	18.1
		5	46.5	11.9	46.3	13.3	45.9	14.9	45.8	16.7	46.4	18.6
		10	52.2	12.0	51.8	13.4	51.4	14.9	51.2	16.8	51.0	18.8
250 Z	Fans 750 rpm	-10	37.9	14.6	39.0	15.5						
		-5	44.2	14.8	44.0	16.5	44.1	18.5				
		0	51.2	14.9	50.8	16.7	50.6	18.6	50.6	20.7		
		5	58.7	15.1	58.1	16.8	57.6	18.7	57.0	20.9	57.4	23.8
		10	68.2	15.2	67.4	16.9	67.0	18.9	65.0	21.0	64.2	23.5
300 Z	Fans 750 rpm	-10	47.5	17.7								
		-5	55.8	18,0	55.2	2000	53.6	21.2				
		0	64.1	18.2	63.2	20.2	63.4	22.5	62.7	25.0		
		5	73.4	18.6	72.8	20.4	71.8	22.7	71.7	25.4	70.0	28.0
		10	83.3	18.6	82.6	20.6	8200	22.9	81.2	25.6	80.	28.4
350 Z	Fans 750 rpm	-10	50.5	20.9	55.7	23.4						
		-5	61.0	21.1	63.5	23.6	64.1	26.4				
		0	72.5	21.4	72.6	23.8	72.7	26.6	73.0	29.8	72.3	31.1
		5	82.2	21.6	81.9	24.0	81.7	26.8	81.5	30.0	81.6	33.5
		10	92.2	21.7	91.6	24.2	91.3	27.0	91.1	30.1	90.6	33.7
400 Z	Fans 750 rpm	-10	103.4	21.8	102.3	24.3	101.4	27.1	100.6	30.3	99.8	33.8
		-5	70.8	23,5	70,3	26,1	69,8	29,0				
		0	81,4	23,7	81,4	26,4	80,3	29,3	80,1	32,7		
		5	92,1	23,9	91,8	26,6	91,8	29,6	90,2	32,9	90,0	36,7
		10	103,5	24,1	103,1	26,8	102,6	29,8	102,4	33,2	101,8	37,0
450 Z	Fans 750 rpm	15	116,0	24,3	115,2	26,9	114,2	29,9	113,4	33,4	112,5	37,2
		-10	71.6	26.2	71.8	29.1						
		-5	82.4	26.5	82.8	29.4	83.1	32.7	82.3	34.9		
		0	94,7	26,8	94,5	29,7	94,7	33,1	94,9	36,8	93,5	39,2
		5	107,1	27,0	106,8	30,0	106,5	33,3	106,5	37,1	106,3	41,3
500 Z	Fans 750 rpm	10	120,6	27,2	119,9	30,2	119,7	33,6	119,1	37,4	118,6	41,6
		15	135,3	27,4	134,5	30,4	133,0	33,8	131,9	37,6	131,0	41,8
		-10	76.8	29.1	77.5	32.3						
		-5	88.3	29.4	88.7	32.7	89.3	36.4				
		0	101.1	29.7	101.3	33.0	101.6	36.7	102.0	41.0	101.4	42.8
600 Z	Fans 750 rpm	5	114.7	30.0	114.3	33.3	114.3	37.0	114.2	41.3	114.4	46.0
		10	128.6	30.2	128.1	33.5	127.6	37.3	127.0	41.5	127.1	46.3
		15	144.1	30.4	143.3	33.7	142.2	37.5	141.4	41.8	140.4	46.6
		-10	94.1	35.0	94.8	39.0	94.5	40.6				
		-5	107.7	35.5	108.4	39.4	109.1	43.9	108.9	46.7		
0	123.5	36.0	124.1	39.9	124.2	44.4	124.5	49.3	123.9	52.5		
5	139.7	36.3	139.9	40.3	139.7	44.8	139.5	49.8	139.6	55.4		
10	157.7	36.7	156.9	40.7	156.2	45.2	156.0	50.2	155.3	55.8		
15	177.1	37.0	175.1	41.1	174.1	45.6	172.7	50.6	171.9	56.3		

PROPELLER
CONDENSER

Pf : Cooling capacity valid a ΔT according to operating limits.

Pa : Compressor power input

(1) Variation of relative humidity for following calculations :
-20°C 95 % RH / + 7°C 85 % RH / + 27°C 50 % RH
Calculation fouling 0,00005 m² °C/W

HEATING CAPACITY



LOW NOISE version



AQUACIAT ILD - ILDH	External air temperature in °C WB (1)	CONDENSER WATER OUTLET TEMPERATURE IN °C										
		30		35		40		45		50		
		Pc kW	Pa kW	Pc kW	Pa kW	Pc kW	Pa kW	Pc kW	Pa kW	Pc kW	Pa kW	
200 Z	Fans 500 rpm	-10	30,0	11,7	30,4	13,0						
		-5	34,5	11,7	34,7	13,2	35,0	14,7				
		0	39,7	11,8	39,6	13,2	39,7	14,8	40,0	16,5		
		5	45,0	11,9	44,7	13,3	44,5	14,9	44,5	16,7	44,8	18,6
		10	50,5	12,0	50,2	13,4	50,1	14,9	49,7	16,7	49,8	18,8
		15	56,7	12,0	56,2	13,4	55,8	15,0	55,5	16,8	54,9	18,9
250 Z	Fans 500 rpm	-10	36,9	14,6								
		-5	42,9	14,8	42,9	16,5	43,0	18,0				
		0	49,7	14,9	49,5	16,6	49,3	18,6	49,1	20,7		
		5	57,4	15,1	57,0	16,8	56,1	18,7	55,8	20,9	55,7	23,3
		10	64,8	15,2	64,4	16,9	64,1	18,8	64,0	21,0	63,7	23,5
		15	72,3	15,3	71,3	17,1	70,9	19,0	70,5	21,3	69,5	23,7
300 Z	Fans 500 rpm	-10										
		-5	53,0	17,9	53,2	19,9						
		0	61,4	18,1	61,0	20,1	60,9	22,5				
		5	71,0	18,3	70,5	20,4	69,8	22,7	69,6	25,3	68,6	27,9
		10	80,0	18,5	79,5	20,5	79,2	22,9	78,7	25,2	78,2	28,4
		15	88,5	18,6	87,9	20,7	87,0	23,0	86,7	25,7	85,5	28,6
350 Z	Fans 500 rpm	-10	53,7	20,9	54,1	23,3						
		-5	61,5	21,1	60,6	23,6	62,2	26,3				
		0	70,1	21,3	70,3	23,8	70,6	26,6	70,2	29,7		
		5	79,3	21,5	79,1	24,0	79,1	26,8	79,2	29,9	79,0	33,4
		10	88,9	21,7	88,4	24,1	88,0	26,9	87,9	30,1	87,8	33,6
		15	99,1	21,8	98,4	24,3	98,0	27,1	97,4	30,2	96,9	33,8
400 Z	Fans 500 rpm	-10										
		-5	68,3	23,4	68,8	26,0	68,8	29,0				
		0	77,1	23,6	78,2	26,3	78,7	29,3	79,1	32,6		
		5	88,2	23,9	88,0	26,5	88,3	29,5	88,5	32,9	88,9	36,7
		10	98,9	24,0	98,5	26,7	98,4	29,7	98,3	33,1	98,5	36,9
		15	110,4	24,2	109,8	26,9	109,3	29,9	108,9	33,3	108,6	37,1
450 Z	Fans 500 rpm	-10	68,9	26,1	69,5	29,0						
		-5	78,9	26,4	80,3	29,3	80,0	32,6				
		0	90,0	26,7	90,2	29,6	90,7	33,0	90,8	36,7	90,9	38,3
		5	102,1	26,9	101,9	29,9	102,0	33,3	102,1	37,0	101,9	41,2
		10	114,5	27,1	114,1	30,1	113,8	33,5	113,5	37,3	113,4	41,5
		15	127,9	27,3	127,2	30,3	126,5	33,7	126,0	37,5	125,4	41,7
500 Z	Fans 500 rpm	-10	73,2	29,0	74,1	32,2						
		-5	84,2	29,3	84,9	32,6	85,9	36,3				
		0	96,2	29,6	96,6	32,9	97,3	36,6	98,0	40,8		
		5	109,0	29,8	108,8	33,2	109,1	36,9	109,6	41,2	110,1	45,9
		10	122,0	30,1	122,0	33,4	121,7	37,2	121,7	41,4	121,9	46,2
		15	135,8	30,3	135,6	33,6	135,2	37,4	134,8	41,7	134,6	46,5
600 Z	Fans 500 rpm	-10	89,7	34,9	90,9	38,8						
		-5	102,8	35,3	104,0	39,3	104,6	43,7				
		0	117,7	35,8	118,0	39,8	118,7	44,2	119,4	49,2	118,8	51,2
		5	132,6	36,2	133,1	40,2	133,1	44,6	133,5	49,6	132,1	55,2
		10	148,5	36,5	148,8	40,6	148,5	45,1	148,4	50,1	148,4	55,7
		15	165,9	36,9	165,8	40,9	165,3	45,4	164,5	50,5	164,1	56,1

PROPELLER
CONDENSER


Pf : Cooling capacity valid a ΔT according to operating limits.

Pa : Compressor power input

(1) Variation of relative humidity for following calculations :
-20°C 95 % RH / + 7°C 85 % RH / + 27°C 50 % RH
Calculation fouling 0,00005 m² °C/W

WATER PRESSURE DROP

AQUACIAT LD - ILD

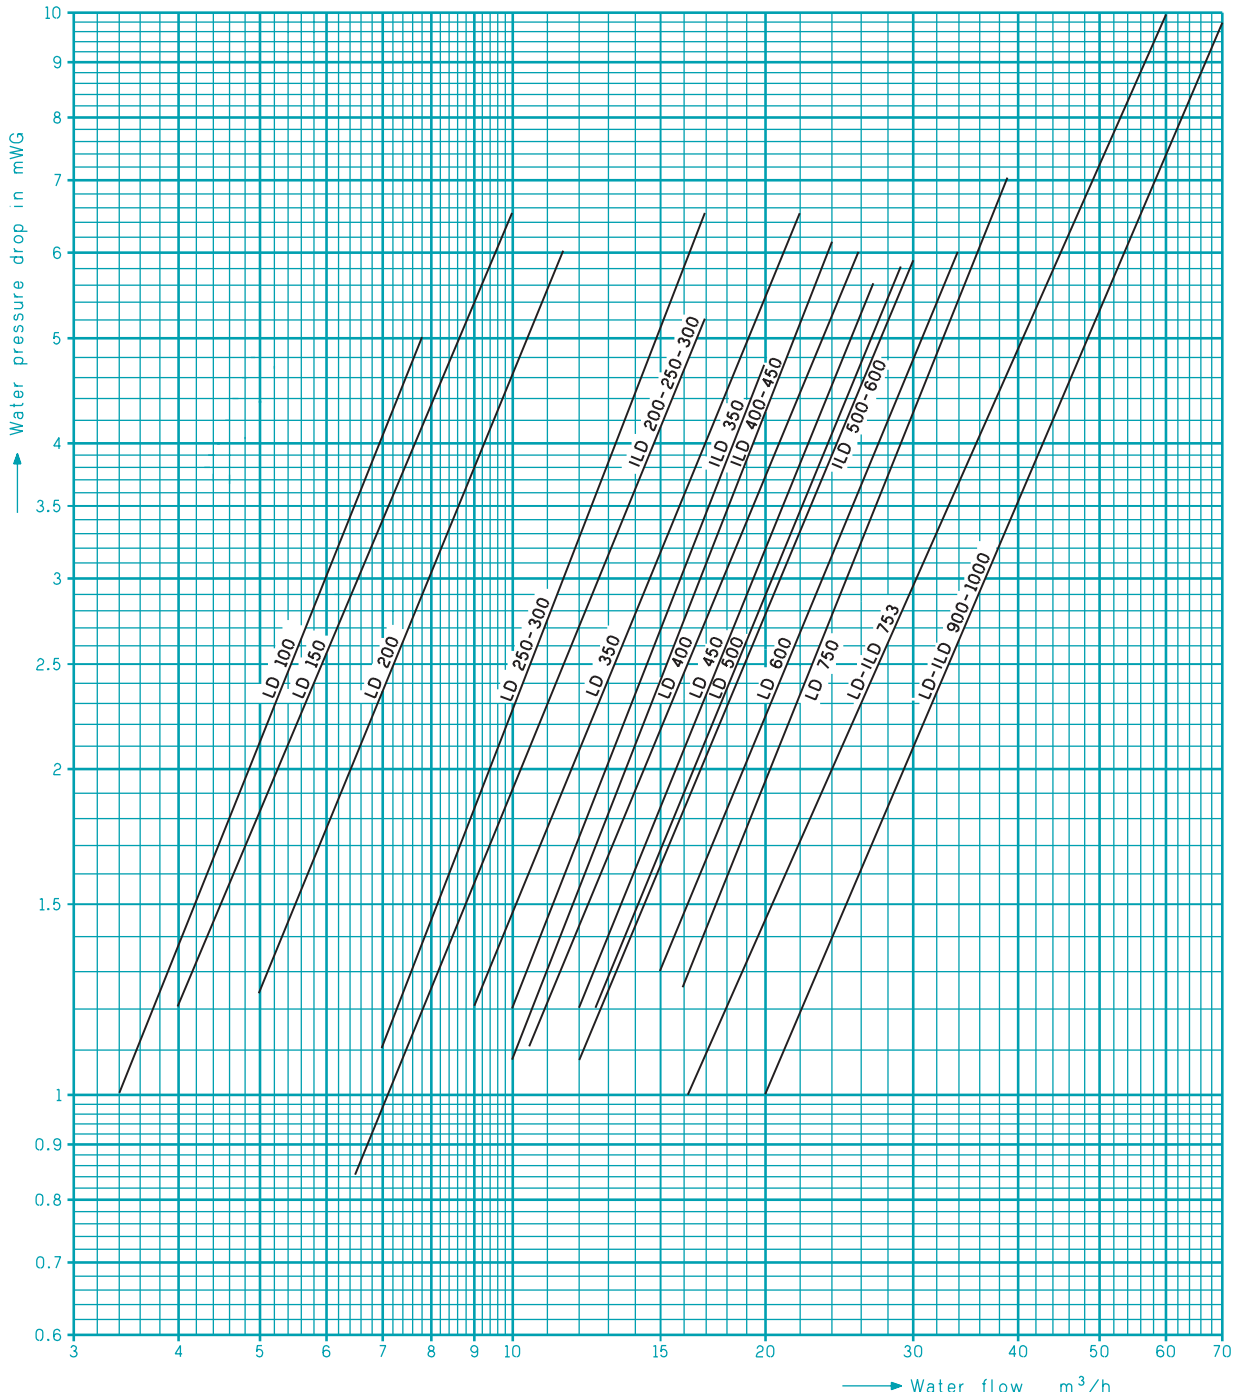


PROPELLER
CONDENSER

WATER PRESSURE DROP


AQUACIAT LDC LDH 100 to 600

Evaporator and hydraulic circuit

PROPELLER
CONDENSER

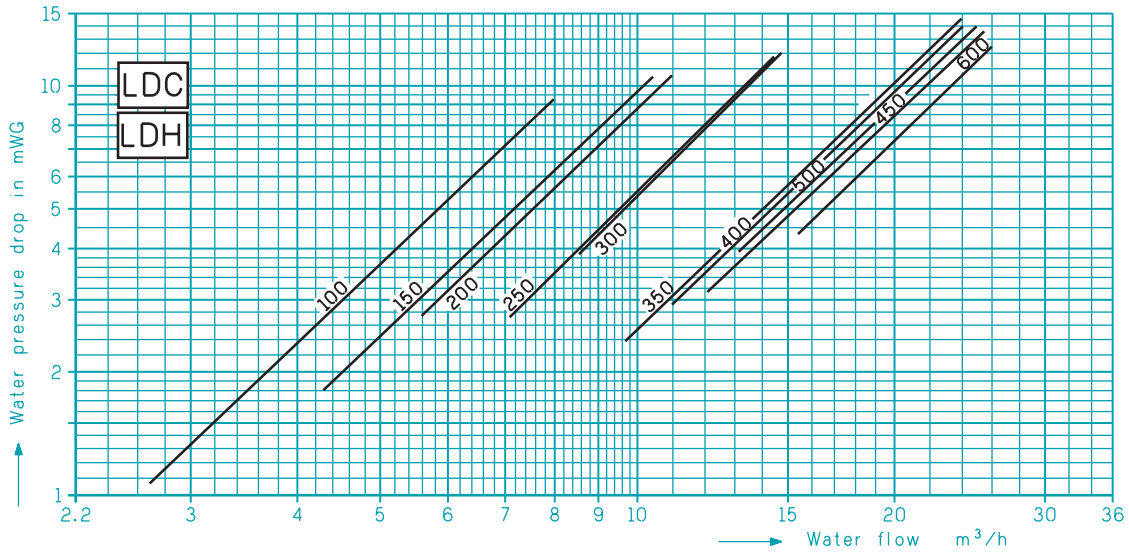


Single pumps or 2 single pumps in parallel

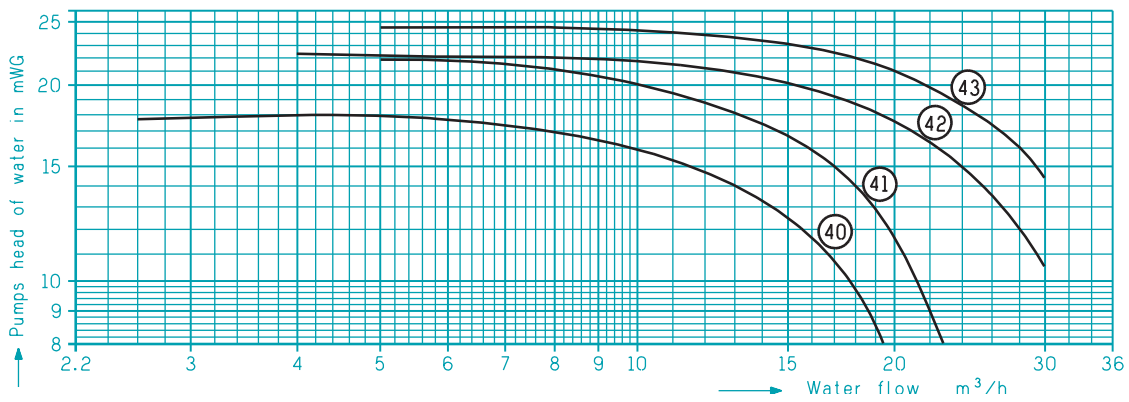

WATER PRESSURE DROP


AQUACIAT ILDH 100 to 600 - ILDHE 200 to 300

Evaporator and hydraulic circuit

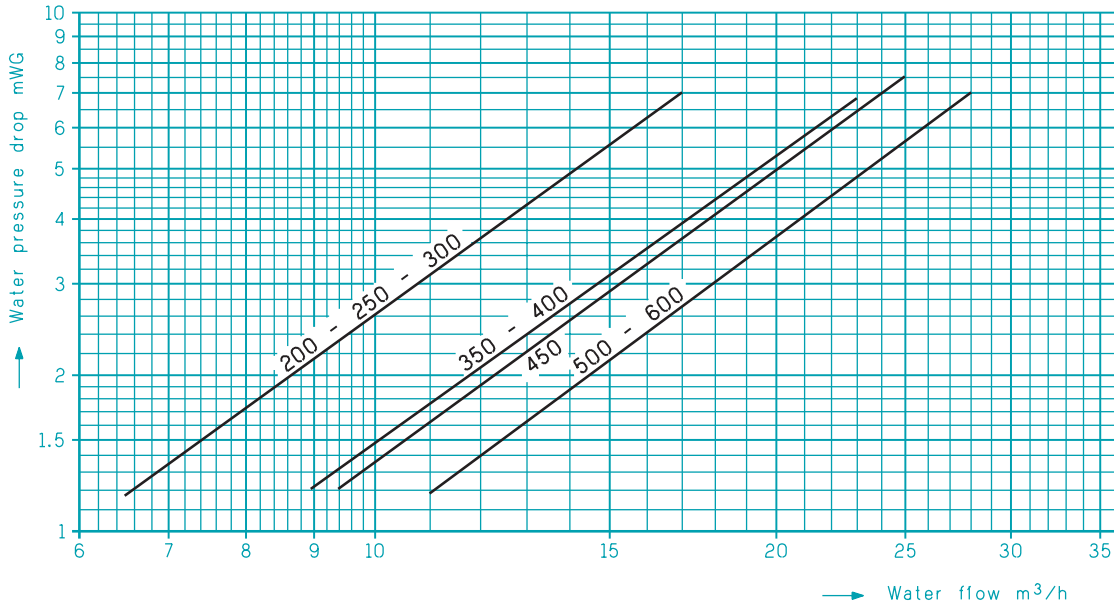

PROPELLER
CONDENSER


Single pumps or 2 single pumps in parallel

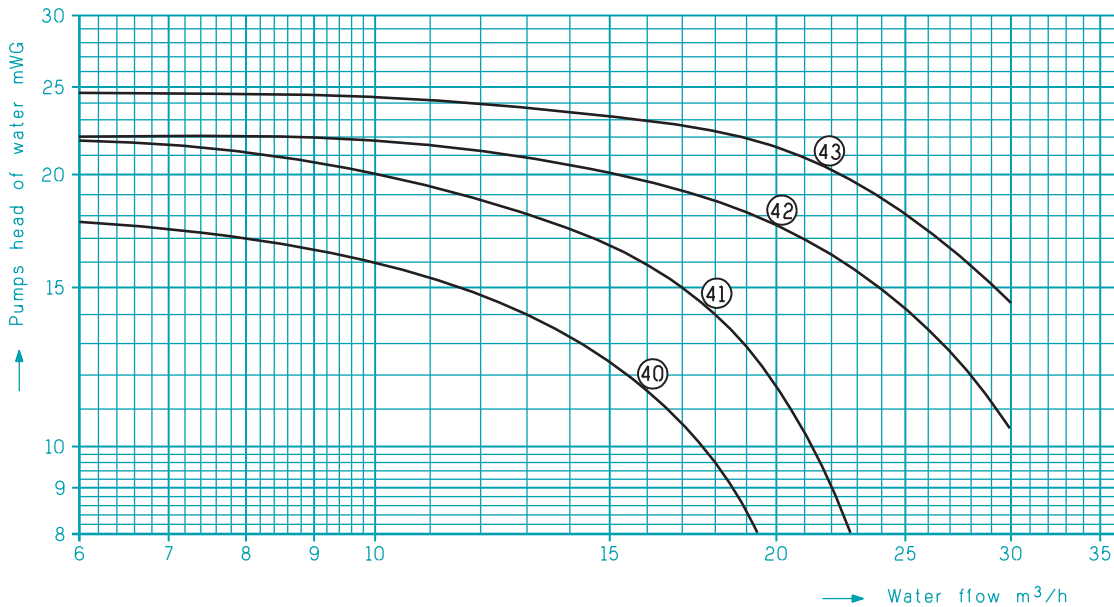

WATER PRESSURE DROP


AQUACIAT (I)LDC - (I)LDH 750 to 1000

PROPELLER
CONDENSER

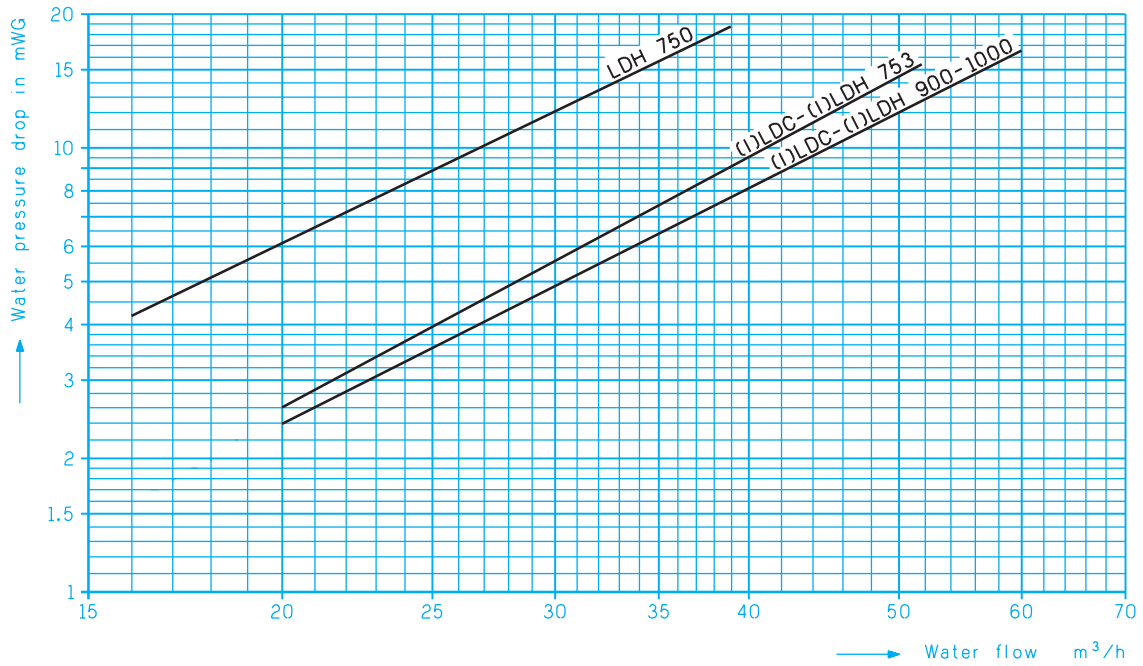

117-118-119 : Single pumps

217-218-219 : Double pumps

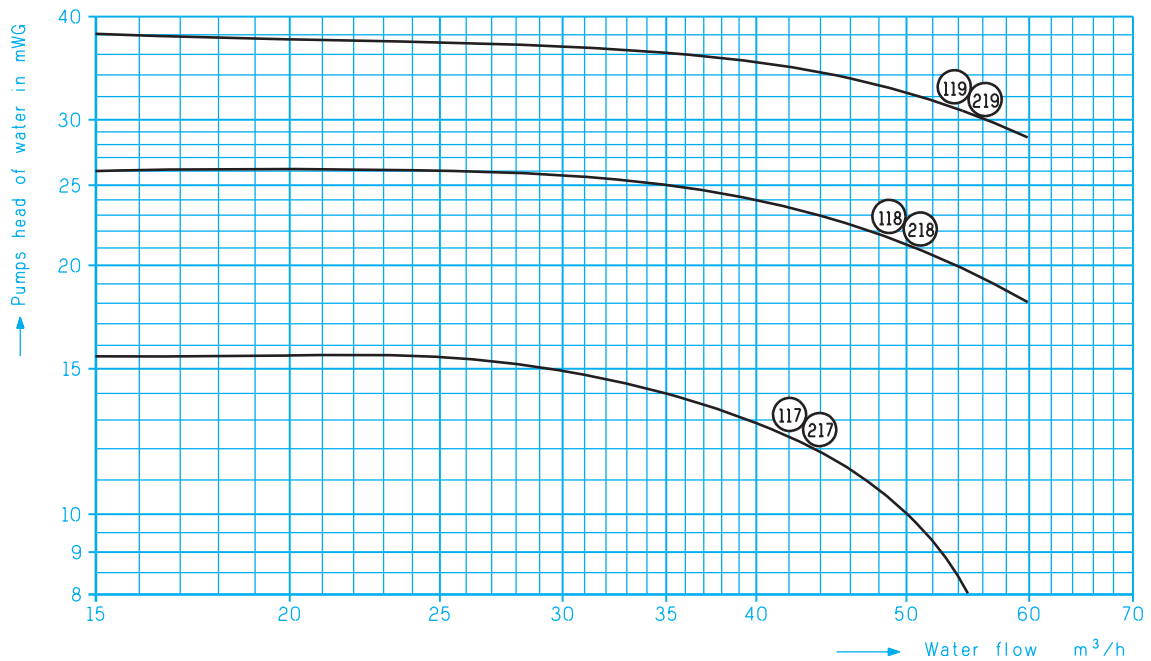



AQUACIAT			100	150	200	250	300	350	400	450	500	600	750	753	900	1000	
Compressor	Type		SCROLL hermetic														
	Number		1	2			3			4	5	3	4				
	Rotation speed rpm		2900														
	LD - LDC LDH	Charge R22/R407C	54	9.2	11.5	14.0	19.0	19.0	21	23.5	26.0	30.0	40.0	43	44	53	
	kg				12.6	16	20	20	26,5	28	32.5	37,6		57.5	62	62	
Capacity control	%		100 - 0		100-50-0	100-40-0	100-50-0	100-70-30-0	100-63-37-0	100-66-33-0	100-70-40-20-0	100-75-50-25-0	100-80-60-20-0	100-66-33-0	100-78-50-28-0	100-75-50-25-0	
Régulateur	LD - LDC - LDH		CONNECT														
	ILD - ILDH		MRS 4.2 A				MRS 3.4 A					CONNECT					
Evaporator	LD - LDC LDH	Type	Brazed plates														
		Number	1						2								
		Water contents l	1,9	2,85	3,39	5,65	7,5	7,95	9,20	9,70	11,4	16,5	15,8				
	ILD - ILDH	Type		Shell and tube									Brazed plates				
		Number		1						2							
		Water contents l		19			25	33		41		16,5	15,8				
Type of Fans		Propeller, diameter 760					Propeller, diameter 900					Propeller, diameter 800					
Air cooled condenser	Number of Fans	LD LDC LDH	1		2					3			4				
		ILD - ILDH	2					3			4						
	500 rpm LOW NOISE	Unitary power kW	0,55					0,90									
		Total air flow. m3/h	LD - LDC LDH	9360	8200	18540	17340	16100	19240	18750	20520	20080	28770	28050	57110	56700	
	ILD - ILDH			18540	17340	16100	20920	21780	20870	22440	29530		57110	56700			
750 rpm STANDARD	Unitary power kW	0,9					1,30										
	Total air flow. m3/h	LD - LDC LDH	15050	13480	29840	28200	26520	31380	31100	33080	32800	46980	46575	68420	66900		
	ILD - ILDH			29840	28200	26520	33720	34780	33650	35620	48200		68420	66900			
LD LDH ILD	Auxiliary capacity l		160			320									500		
	Expansion vessel Capacity l		18		LDC 18 / LDH 24				24				35				
	Pressure bar		1,5														
○ Max. installation capacity in liters (2)																	
Hydraulic module (1)	Pure water	○ water max 36 °C (3)	1700			2150			2700					5760			
		○ water max 46 °C (3)	900			1100			1900					3523			
	Glycol water	○ water max 36 °C (3)	1200			1500			2250					4230			
		- water max 46 °C (3)	550			650			1400					2642			
	Pump standard	ILDH - ILDH - LDC	N°/kW	40/0.75			41/1.15			According to installation requirement (selection in chart)							

(1) LDH - LDC - ILDH only

(2) Capacity of the installation as a function of the expansion vessel mounted on the unit.

The auxiliary tank is already taken into account. In the case where the installation capacity is higher, an expansion vessel must be added on the installation corresponding to the surplus capacity.

(3) The water temperatures mentioned are the temperatures which can be reached when the unit is stopped.

ELECTRICAL CHARACTERISTICS

PROPELLER
CONDENSER

AQUACIAT		100	150	200	250	300	350	400	450	500	600	750	753	900	1000
		COMPRESSOR(S)													
Max. nominal current in A	* 230 V	35,1	50,9	70,2	86,0	101,8	121,1	136,9	152,7	172,0	203,6	254,5	-	-	-
	400 V	19,8	29,2	39,6	49,0	58,4	68,8	78,2	87,6	98,0	116,8	146,0	142,5	172	190
		FAN MOTORS 500 rpm													
Max. nominal current in A	* 230 V	2		4 (2 x 2)			7 (2 x 3,5)			10,5 (3 x 3,5)		13,2 (3 x 3,3)			
	400 V	1,15		2,3 (2 x 1,15)			4 (2 x 2)			6 (3 x 2)		7,6 (4 x 1,9)			
		FAN MOTORS 750 rpm													
Max. nominal current in A	* 230 V	3,65		7,3 (2 x 3,65)			14 (2 x 7)			21 (3 x 7)		26,4 (4 x 6,6)			
	400 V	2,1		4,2 (2 x 2,1)			8 (2 x 4)			12 (3 x 4)		15,2 (4 x 3,8)			
		START-UP CHARACTERISTICS (EXCLUDING PUMP FOR HYDRAULIC MODELS)													
Max. nominal current in A	* 230 V	229,2	344,7	267,9	383,4	399,2	425,2	441	456,8	476,1	514,7	565,6	-	-	-
	400 V	134,1	194,6	156	216,5	225,9	240,1	249,5	258,9	269,3	292,1	321,3	380	410	430

AQUACIAT		100	150	200	250	300	350	400	450	500	600	750	753	900	1000
		ANTI-FROST PROTECTION LD - LDC - ILD													
Power	W	100				3 x 100				(I)LD : 1200 (I)LDC : 1300					
Max. nominal current in A	1 ph. 230 V	0,45				0,9				-					
	TRI 400 V	-				-				(I)LD : 1,73 (I)LDC : 1,88					
		ANTI-FROST PROTECTION + HYDRAULIC CIRCUIT LDH - ILDH													
Power	W	1500 (3 x 500)				2800									
Max. nominal current in A	* 230 V	6,9 (3 x 2,3)													
	400 V	6,9 (3 x 2,3)				4,04									

SINGLE pump ** (versions LDH - LDC - ILDH)		N°	40	41	42	43	117	118	119
230* / 400 V 3 ph - 50 Hz + earth	Power	kW	0,75	1,1	1,5	1,85	2,2	4	7,5
	Max. nominal current in A	* 230 V	3,22	4,64	5,9	8,02	-	-	-
		400 V	1,85	2,67	3,9	4,61	4,5	7,8	13,8

** Models 100 to 300 are equipped, in the standard version, with the pumps mentioned in the table.

DOUBLE pump ** (versions LDH - LDC - ILDH)		N°	217	218	219
230* / 400 V 3 ph - 50 Hz + earth	Power	kW	2,2	4	7,5
	Max. nominal current in A	* 230 V	-	-	-
		400 V	4,5	7,8	13,8


* 230 V - 3 ph : Controlled voltage in France

Total intensity of unit : sum of the max. nominal intensities mentioned in the above tables.

SOUND LEVELS

The AQUACIAT LD(C / H) and ILD (H) range is strictly designed to combine the "noiseless" assembly techniques for attenuation of vibrations and sound sources.

- SCROLL compressor(s) located outside the air flow ①.
- Anti-vibration mounting of several compressors on a structure isolated from the frame ②.
- Pipework independent from the unit structure.
- Low speed fans (500 rpm) LOW NOISE ③.
- Antivibratil mounts supplied as standard Æ ④.

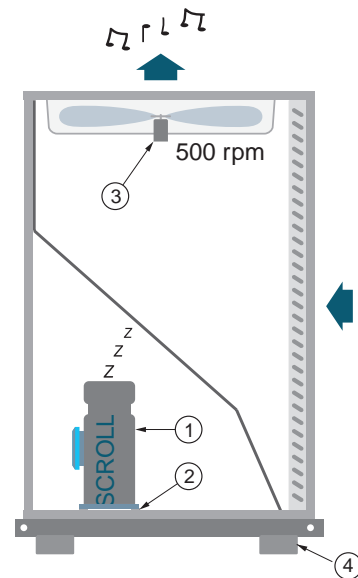

PROPELLER
CONDENSER

- Acoustic pressure levels ref 2×10^{-5} Pa ± 3 dB

Measurement conditions :

- Compressor(s) + fan(s) at low speed (500 rpm) LOW NOISE
- Free field
- 10 m distance from the unit, 1.50 m from the ground
- Directivity 2

AQUACIAT	PRESSURE LEVEL SPECTRUM (dB)							Total level dB(A)
	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	
100	63	54	47	47	43	40	34	48
150	60	57	48	46	46	40	40	50
200	66	57	50	50	46	43	37	51
250	60	53	51	49	45	40	39	50
300	61	55	53	49	46	41	39	51
350 - 400 - 450 - 500	67	60	55	52	48	43	37	54
600 - 750	62	61	57	55	50	46	40	56
753	-	54.5	54.5	56.1	52.5	48.7	44.6	57.5
900 - 1000	-	55.7	55.7	57.3	53.8	50	45.9	58.8

NOTE : we remind that the acoustic pressure level is given as an indication and that only the sound power level is comparable and certified.

Following ISO 3744 Norm $L_p = L_w - 10 \log S$

- Acoustic power levels ref 2×10^{-12} W ± 3 dB

Measurement conditions :

- Compressor(s) + fan(s) at low speed (500 rpm) LOW NOISE

AQUACIAT	POWER LEVEL SPECTRUM (dB)							Total level dB(A)
	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz	
100	91	82	75	75	71	68	62	76
150	88	85	76	74	74	68	68	78
200	94	85	78	78	74	71	65	79
250	88	81	79	77	73	68	67	78
300	89	83	81	77	74	69	67	79
350 - 400 - 450 - 500	96	89	84	81	77	72	66	83
600 - 750	91	90	86	84	79	75	69	85
753	-	83.5	83.4	85.1	81.5	77.7	73.6	86.5
900 - 1000	-	84.7	84.7	86.3	82.8	79	74.9	87.8

VERSION WITH HYDRAULIC KIT

AQUACIAT the all-in solution

The PLUG & COOL solution with AQUACIAT

The AQUACIAT hydraulic pack integrates in all the components of the hydraulic circuit required for a normal operation of the circuit.

PROPELLER
CONDENSER

AQUACIAT	ILDH	LDH	LDC
Buffer tank	●	●	-
Expansion vessel	●	●	●
Water flow controller	●	●	●
Pressure gauge with isolating valve	●	●	●
Anti-frost protection of the whole circuit	●	●	●
Drain circuit	●	●	●
Manual and automatic purge	●	●	●

AQUACIAT	ILDH	LDH	LDC
Safety valve	●	●	●
Filling hole with valves	100 - 750	100 - 750	100 - 600
Large choice of single or double pumps	●	●	●
Adjusting valve	100 - 750	100 - 750	100 - 600
Water filter	●	●	●
Regulation of the assembly	●	●	●


The AQUACIAT installation is very easy, this unit being equipped with an hydraulic pack whose components are selected in an optimal way, mounted and tested in factory, The design of components, supplies, connections is no longer necessary..

Delivered fully equipped, the AQUACIAT is ready to operate.


In short, the AQUACIAT hydraulic pack optimizes the preparation and operation time and the required.space.

Connecting, cooling ... ; with AQUACIAT everything becomes simple and economical.

HYDRAULIC DIAGRAM ILDH 200 - 600, LDH 100 - 750, (I) LD (H / C) 753 -1000

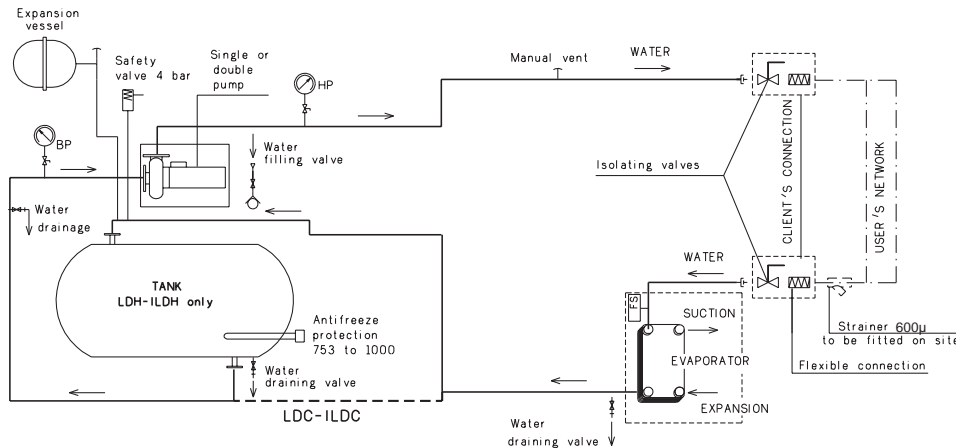

HYDRAULIC DIAGRAM LDC 100 - 600

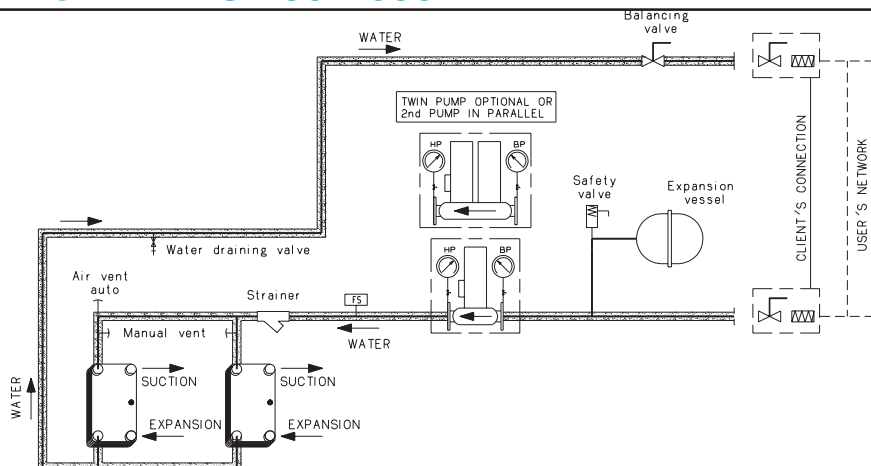

DIMENSIONS

AQUACIAT 100 to 300 LD - LDC - ILD

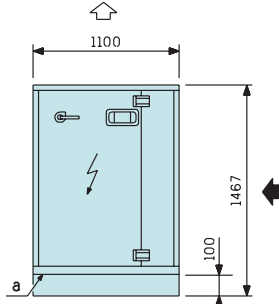


Fig.1





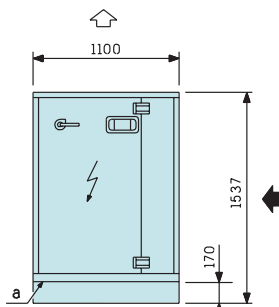


Fig.2

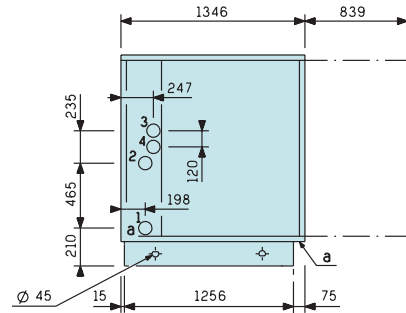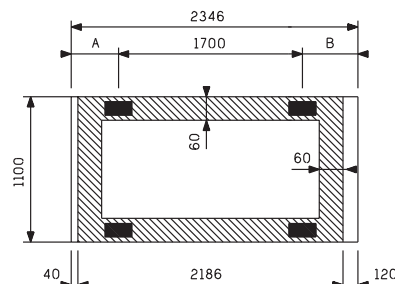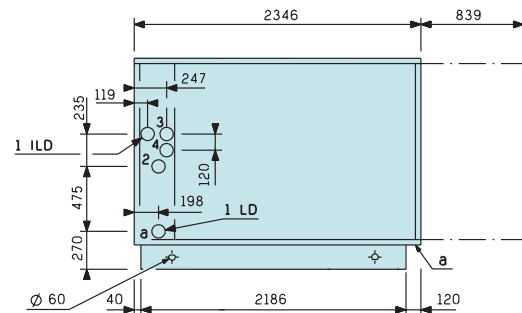

➔ External air inlet

⬅ External air discharge

1-Water outlet 2-Desuperheater outlet

2-Water inlet 2-Desuperheater inlet

a Electrical supply \varnothing 45mm: 100-150
 \varnothing 60mm: 200-250-300

■ Anti-vibration mounts optional

A clear space of 1 m on all sides for the units should be allowed for servicing and maintenance operations.

AQUACIAT Series	100	150	200	250	300	200	250	300	
	LD / LDC					ILD			
FIG.	1	1	2	2	2	2	2	2	
1 = \varnothing G	1" 1/4	1" 1/4	2"	2"	2"	2"	2"	2"	
2 = \varnothing G	1" 1/4	1" 1/4	2"	2"	2"	2"	2"	2"	
3 = \varnothing G	3/4"	3/4"	1" 1/2	1" 1/2	1" 1/2	1" 1/2	1" 1/2	1" 1/2	
4 = \varnothing G	3/4"	3/4"	1" 1/2	1" 1/2	1" 1/2	1" 1/2	1" 1/2	1" 1/2	
A	236	246	306	286	276	331	321	306	
B	210	200	340	360	370	315	325	340	
Mass in kg	In service	415/450	450/485	710/745	755/790	795/830	780	820	860
	Empty	400/430	435/465	690/720	735/765	775/805	760	800	840

DIMENSIONS

AQUACIAT 100 to 300 LDH - ILDH

PROPELLER
CONDENSER

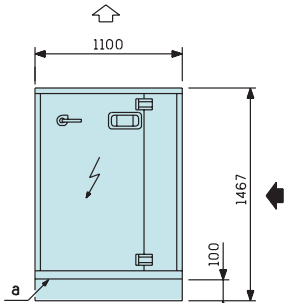


Fig.1





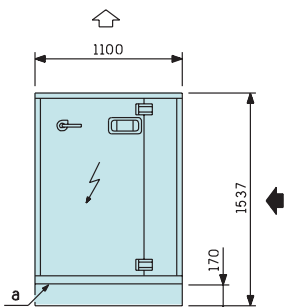


Fig.2

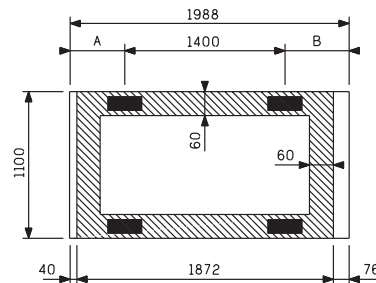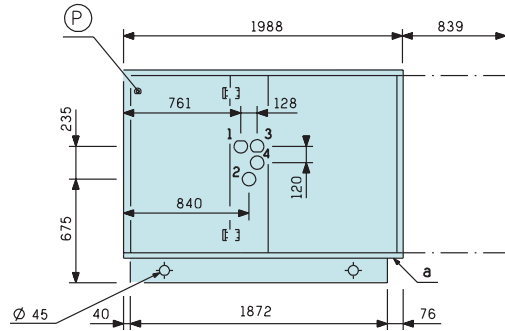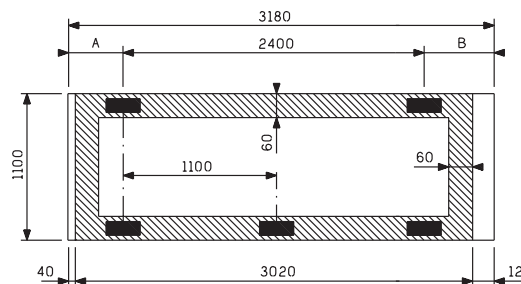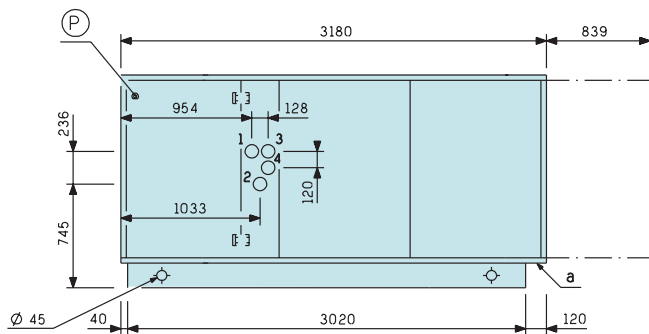

External air inlet

External air discharge

1-Water outlet 2-Desuperheater outlet

2-Water inlet 2-Desuperheater inlet

a Electrical supply \varnothing 45mm: 100-150

\varnothing 60mm: 200-250-300

Anti-vibration mounts optional

A clear space of 1 m on all sides for the units should be allowed for servicing and maintenance operations.

AQUACIAT Series	100	150	200	250	300	200	250	300	
	LDH					ILDH			
FIG.	1	1	2	2	2	2	2	2	
1 = \varnothing G	1" 1/4	1" 1/4	2"	2"	2"	2"	2"	2"	
2 = \varnothing G	1" 1/4	1" 1/4	2"	2"	2"	2"	2"	2"	
3 = \varnothing G	3/4"	3/4"	1" 1/2	1" 1/2	1" 1/2	1" 1/2	1" 1/2	1" 1/2	
4 = \varnothing G	3/4"	3/4"	1" 1/2	1" 1/2	1" 1/2	1" 1/2	1" 1/2	1" 1/2	
A	253	283	255	270	290	315	330	345	
B	335	305	525	510	490	465	450	435	
Mass in kg	In service	830	865	1400	1445	1485	1470	1510	1550
	empty	655	690	1080	1125	1165	1150	1190	1230

DIMENSIONS

AQUACIAT 350 to 750 LD - LDC

AQUACIAT 350 to 600 ILD

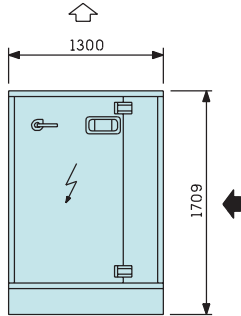


Fig.1

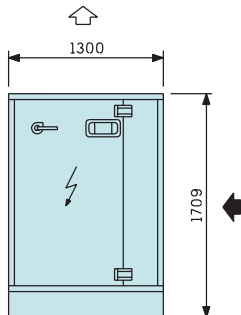
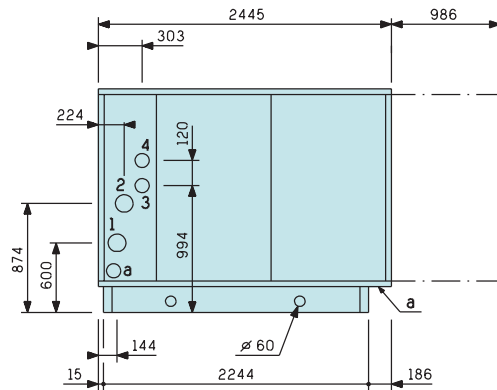


Fig.2



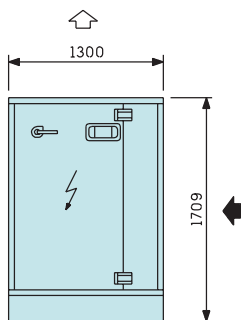


Fig.3

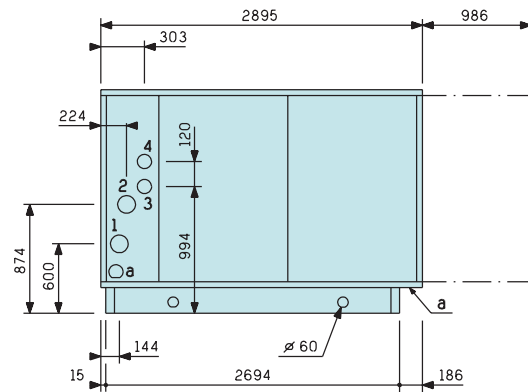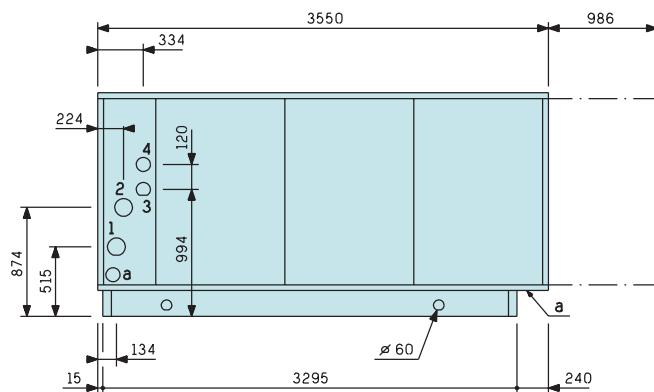

➡ External air inlet

↖ External air discharge

1-Water outlet 2-Desuperheater outlet

2-Water inlet 2-Desuperheater inlet

a Electrical supply \varnothing 60mm

PROPELLER
CONDENSER


AQUACIAT Series	350	400	450	500	600	750	350	400	450	500	600	
	LD / LDC						ILD					
FIG.	1	1	2	2	3	3	1	2	2	3	3	
1 = \varnothing G	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	
2 = \varnothing G	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	
3 = \varnothing G	1"	1"	1"1/4	1"1/4	1"1/2	1"1/2	1"	1"	1"1/4	1"1/4	1"1/2	
4 = \varnothing G	1"	1"	1"1/4	1"1/4	1"1/2	1"1/2	1"	1"	1"1/4	1"1/4	1"1/2	
Mass in kg	In service	1215/1260	1293/1336	1473/1516	1555/1600	1732/1777	1957	1311	1513	1665	1753	1964
	Empty	1202/1232	1278/1308	1458/1488	1540/1570	1717/1747	1942	1284	1479	1630	1679	1920

DIMENSIONS

AQUACIAT 350 to 750 LD - LDC


AQUACIAT 350 to 600 ILD

PROPELLER
CONDENSER

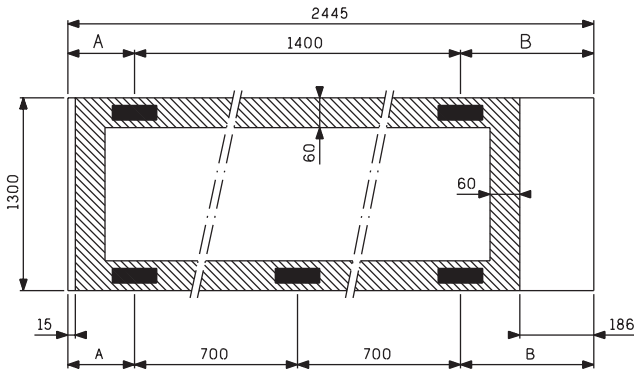


■ Anti-vibration mounts optional

AQUACIAT	350	400	350
Series	LD - LDC		ILD
A	582	592	561
B	463	453	484

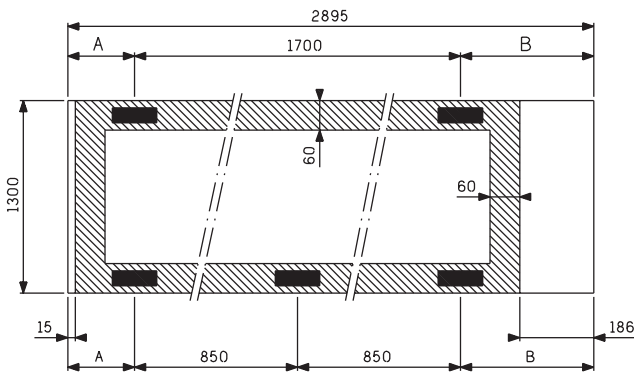

■ Anti-vibration mounts optional

AQUACIAT	450	500	400	450
Series	LD - LDC		ILD	
A	728	712	513	451
B	467	483	683	744

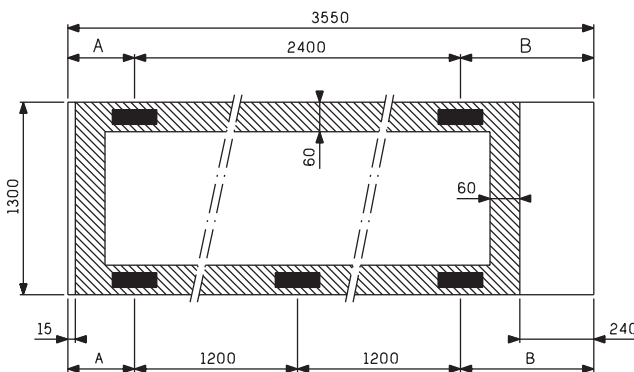

■ Anti-vibration mounts optional

AQUACIAT	600	750	500	600
Series	LD - LDC	LD	ILD	
A	603	584	556	492
B	547	566	594	658

DIMENSIONS

AQUACIAT 350 to 750 LDH

AQUACIAT 350 to 600 ILDH

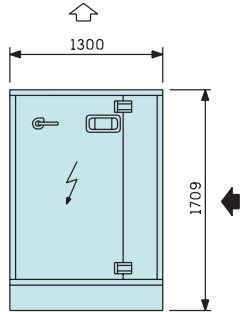


Fig.1

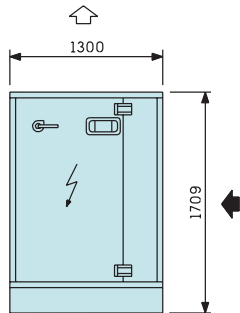
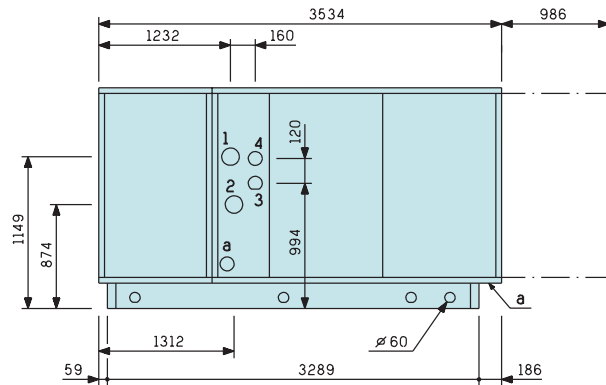


Fig.2



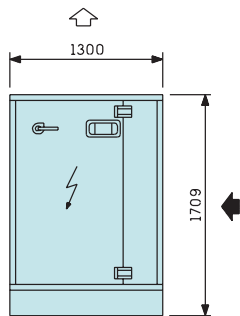


Fig.3

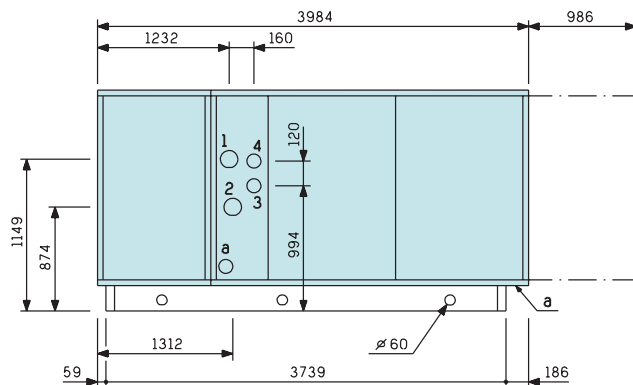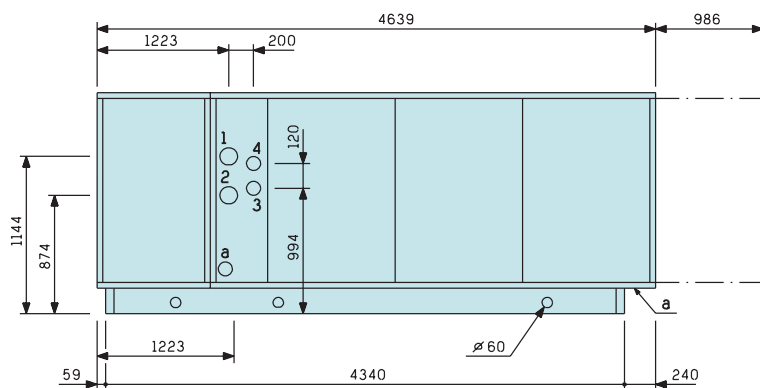

➡ External air inlet

↗ External air discharge

1-Water outlet 2-Desuperheater outlet

2-Water inlet 2-Desuperheater inlet

a Electrical supply \varnothing 60mm

AQUACIAT	350	400	450	500	600	750	350	400	450	500	600	
Series	LDH						ILDH					
FIG.	1	1	2	2	3	3	1	2	2	3	3	
1 = \varnothing G	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	
2 = \varnothing G	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	2"1/2	
3 = \varnothing G	1"	1"	1"1/4	1"1/4	1"1/2	1"1/2	1"	1"	1"1/4	1"1/4	1"1/2	
4 = \varnothing G	1"	1"	1"1/4	1"1/4	1"1/2	1"1/2	1"	1"	1"1/4	1"1/4	1"1/2	
Mass in kg	In service	2036	2112	2252	2333	2552	2767	2131	2341	2492	2568	2792
	Empty	1658	1764	1904	1985	2202	2427	1769	1965	2115	2174	2407


PROPELLER CONDENSER

DIMENSIONS


AQUACIAT 350 to 750 LDH

AQUACIAT 350 to 600 ILDH


PROPELLER
CONDENSER

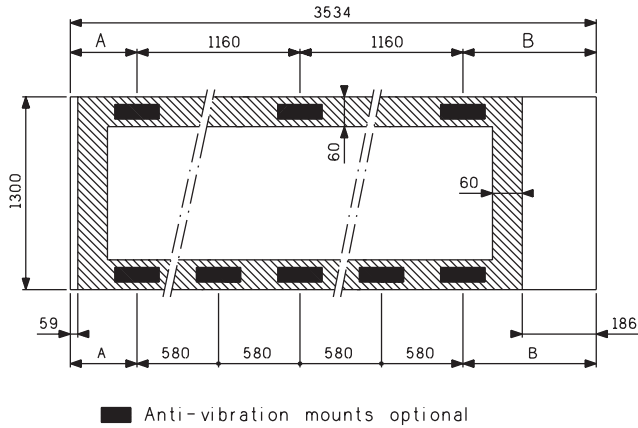

AQUACIAT	350	400	350
Series	LDH		ILDH
A	348	410	376
B	866	804	838

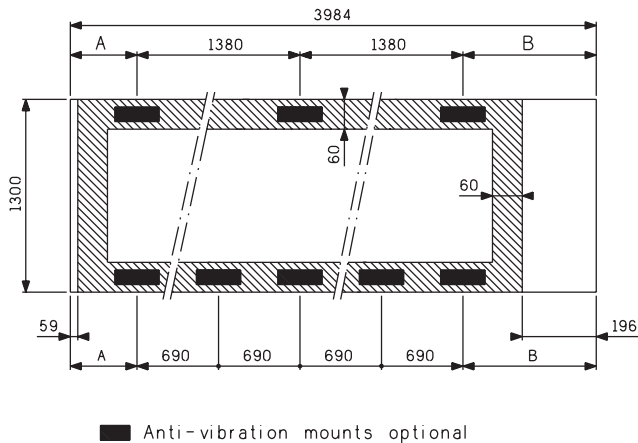









AQUACIAT	450	500	400	450
Series	LDH		ILDH	
A	401	406	284	288
B	823	818	940	936

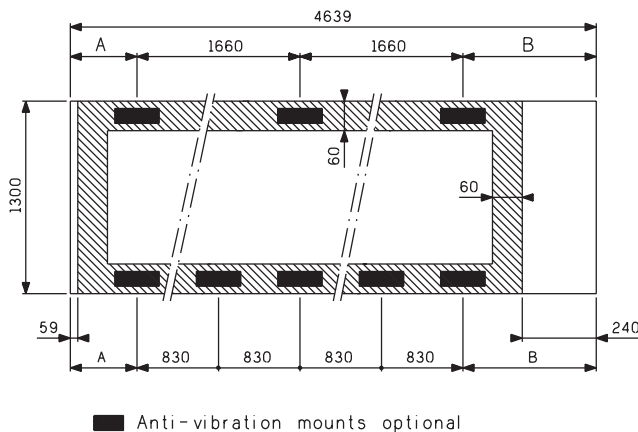

AQUACIAT	600	750	500	600
Series	LDH		ILDH	
A	360	419	322	353
B	959	900	997	966

DIMENSIONS

AQUACIAT (I)LD - (I)LDH - (I)LDC 753 - 900 - 1000

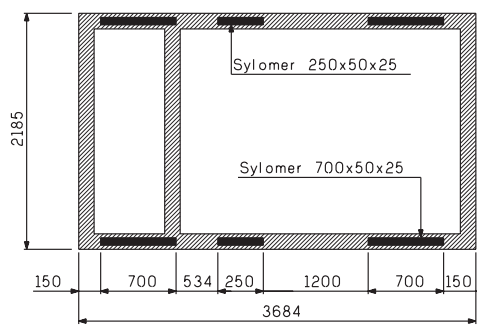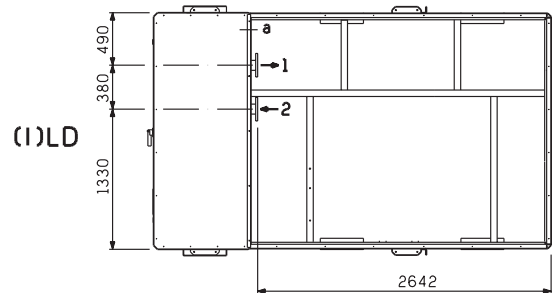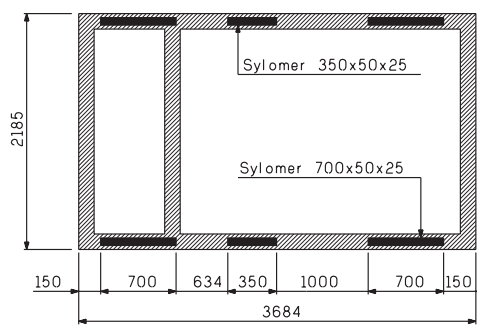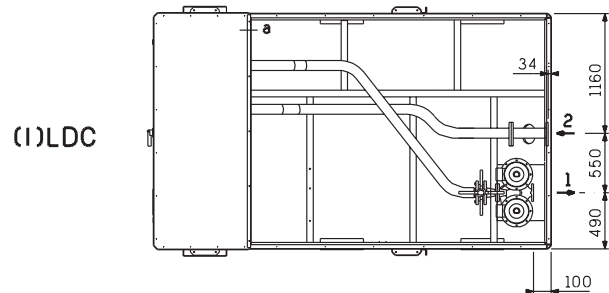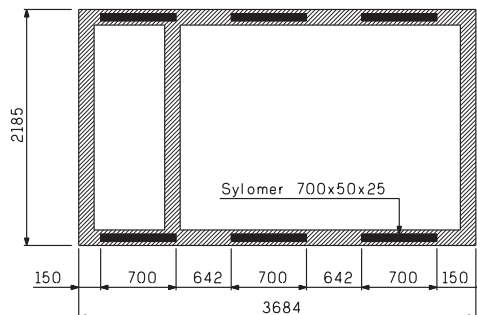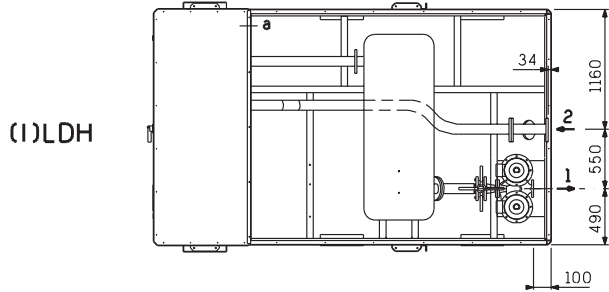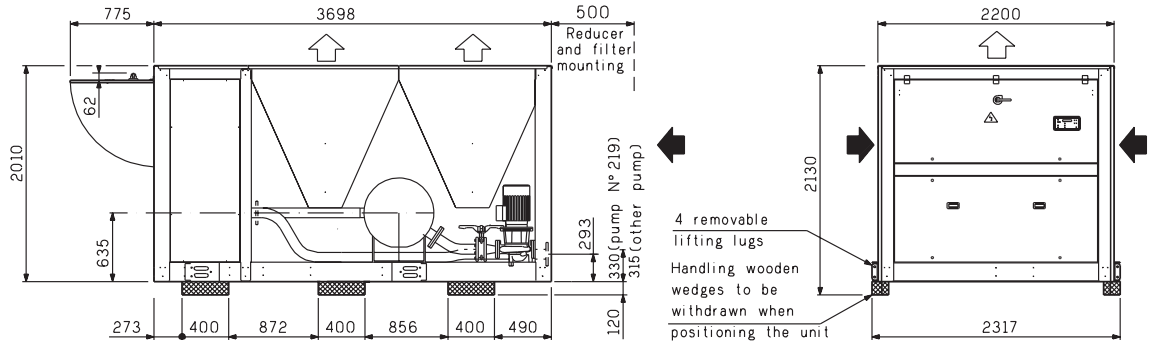

A clear space of 1 m on all sides for the units should be allowed for servicing and maintenance operations.

a : Electrical supply \varnothing 80mm
 1 : Chilled water outlet Flange DN 100
 2 : Chilled water inlet Flange DN 100

PROPELLER CONDENSER


AQUACIAT		753	(I)LD 900	1000	753	(I)LDC 900	1000	753	(I)LDH 900	1000
DN flange	1					100				
	2									
Mass in kg	In service	2050	2225	2225	2325	2500	2500	2975	3150	3150
	Empty	2025	2200	2200	2275	2450	2450	2425	2600	2600

DIMENSIONS

AQUACIAT (I)LD - (I)LDH - (I)LDC 753 - 900 - 1000


PROPELLER
CONDENSER

Top view
(I)LD - (I)LDH - (I)LDC
N° 753 - 900 - 1000

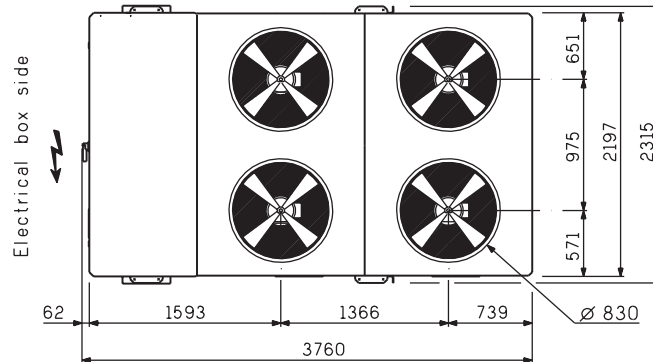

GROUND FIXATION OF FRAME

AQUACIAT LD - LDC - LDH - ILD - ILDH

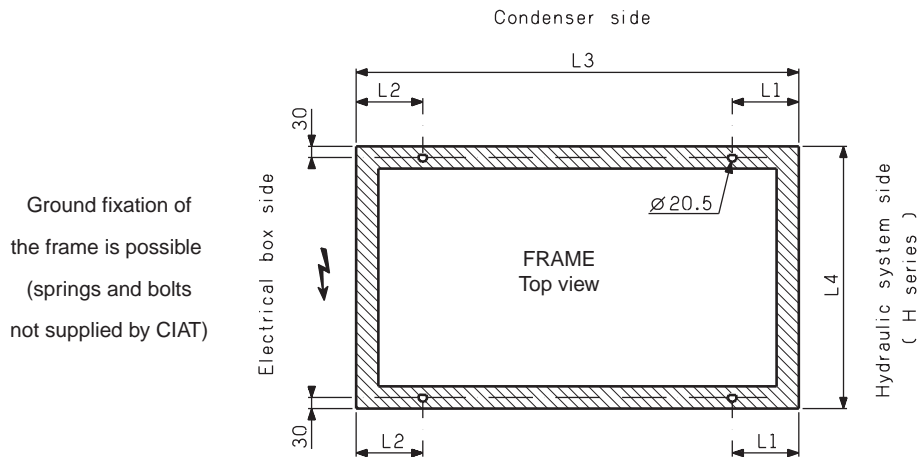

AQUACIAT	LD - LDC				LDH				ILD				ILDH			
	L1	L2	L3	L4	L1	L2	L3	L4	L1	L2	L3	L4	L1	L2	L3	L4
100 - 150	150	150	1256	1100	180	180	1872	1100								
200 - 250 - 300	180	180	2186	1100	180	300	3020	1100	180	180	2186	1100	180	300	3020	1100
350	489	360	2244	1300	549	610	3289	1300	489	360	2244	1300	549	610	3289	1300
400	489	360	2244	1300	549	610	3289	1300	489	510	2694	1300	529	510	3789	1300
450	489	510	2694	1300	529	510	3789	1300	489	510	2694	1300	529	510	3789	1300
500	489	510	2694	1300	529	510	3789	1300	580	640	3295	1300	582.5	640	4340	1300
600	580	640	3295	1300	582.5	640	4340	1300	580	640	3295	1300	582.5	640	4340	1300
750	580	640	3295	1300	582.5	640	4340	1300								
753 - 900 - 1000	986.5	985.5	3684	2185	986.5	985.5	3684	2185	986.5	985.5	3684	2185	986.5	985.5	3684	2185

INSTALLATION RECOMMENDATIONS

AQUACIAT serie LD - LDC - LDH - ILD - ILDH

■ Location :

The instructions given in the Installation, Operation, Commissioning and Maintenance manual must be respected.

The **AQUACIAT** units must be positioned outside a plant room, sheltered from adverse weather and frost, in conformity with the regulations existing in the country of installation.

Piping must be protected from frost

- Leave a free space all around the unit to allow access to the control panel and technical compartments and to ensure a correct air flow.
- Possible harmful effects due to noise are to be carefully studied.

Therefore, before positioning, study and treat the various possible noise transmissions ; The assistance of an acoustic specialist may be usefull.

- The unit must be levelled on resilient mounts.
- If required, fit the pipework with rubber expansion joints (optional)

■ Operations to be carried out before lifting the unit :

Follow the recommendations affixed on the machine or the instructions in the Installation, Operation, Commissioning and Maintenance manual.

■ . Mounting of the accessories delivered separately :

The instructions in the Installation, Operation, Commissioning and Maintenance manual must be respected.

Several accessories, delivered separately, can be mounted on the unit on site.

■ Electrical wiring :

The instructions in the Installation, Operation, Commissioning and Maintenance manual must be respected.

- All necessary instructions for electrical connections are detailed on the wiring diagrams enclosed with the unit. They must be strictly followed.
- These connections must be made in accordance with good engineering practice and must conform to regulations in force.
 - . Main three phase electric power supply
 - . Earth connection
 - . Single phase electrical supply to the control box (depending on the models)
 - . Remote control of the machine or volt free contact signals (optional)
- It is important to note that the chiller has no lightning protection
- Therefore, adequate protective devices against these transient phenomena must be planned and integrated on the electrical supply on site.
- The machine must always be live to ensure the internal frost protection

■ Piping connections :

The instructions in the Installation, Operation, Commissioning and Maintenance manual must be respected.

All pipes must be correctly aligned and sloped toward the drain valve to permit complete drainage of the system. Pipes must be installed and connected to the machine, making sure that there is a free access to the panels.... Thermal insulation must be provided.

- Pipes supports and fixations must be independant to avoid vibration and strains on the unit
- On-site connections required (evaporator, discharge and draining)
- Provide the accessories necessary for all hydraulic circuits, for example :
 - water expansion vessel,
 - drain valves on lower points of pipes for water drainage
 - circuit isolating valves and filters
 - air vents on upper points of pipes
 - check that there is a sufficient water volume in the installation (if necessary, provide a storage tank)
 - manual valve to adjust the water flow
 - thermometers at each inlet and outlet connection for measurement necessary during commissioning and maintenance operations



Caution :

- Water circuit pressure must not exceed 4 bar
- Expansion vessel mounted before the water pump
- Do not install any valve on the expansion vessel
- Make sure to install the water circulating pump immediately on the exchanger water inlet side
- Make sure that the water pressure at the circulating pump suction is equal to or higher than the minimum pressure NPSH required, particularly in case of an " open " type circuit
- The water quality criteria have to be analysed.
- Frost protection devices are required for the machine and hydraulic installation, in particular draining possibility of the circuit.
- In case of glycol being used against frost, check its physical properties and concentration before starting the unit
- Before carrying out the final hydraulic connections, the pipes must be flushed with clean water to remove possible debris.

■ Commissioning

WARNING :

A water filter (600 microns) must be mounted on the unit inlet by the installer. Isolating valves and manual valves for water flow adjustment must also be installed.

Follow the instructions in the Installation, Operation, Commissioning and Maintenance manual.

The commissioning of the AQUACIAT units must be carried out by CIAT or a company agreed by CIAT

Non exhaustive list of operations to be carried out during commissioning :

- Check the correct location of the machine
- Verification of the electrical supply protection
- Verification of the phases and correct rotation direction
- Verification of the electrical connections on the unit
- Verification of the correct sense of water circulation on the unit
- Verification of the water circuit cleanliness
- Water flow adjustment to the specified value
- Verification of the refrigeration circuit pressures
- Verification of the correct compressors rotation direction
- Verification of the water pressure drops and water flows
- Completion of running parameters check list

■ Maintenance operations and Warranty

Comply with the instructions in the Installation, Operation, Commissioning and Maintenance manual.

The AQUACIAT chillers require specific routine maintenance operations which must be carried out by CIAT authorized Companies.

A report of the running parameters must be completed on the " check list " form and returned to CIAT

It is necessary to take out a maintenance contract for the unit with a specialist on refrigeration machines agreed by CIAT, even for the warranty period.

RÉGULATION CONNECT



ERGONOMIC INTERFACE PANEL

- LCD multilingual screen (2 lines of 20 characters)
- Pressures and temperatures reading
- Pump control
- Communication

Available free contacts inputs / outputs

- Inputs :*
- External ON/OFF contact
 - Setpoint 1/2 selection
 - Cooling / heating selection
 - Compressors load shedding

- Outputs :*
- General fault of the unit

RS 485 OUTPUT IN STANDARD

MODBUS-JBUS open Protocol

FREE CONTACTS RELAY CARD (OPTION)

- Available outputs :*
- Water flow fault
 - Antifreeze fault
 - Pump fault
 - Fans fault
 - Low and high pressure fault
 - Compressors safety fault
 - Discharge temperature fault
 - Compressors running status

REMOTE CONTROL BOX (OPTION)

Identical to the ergonomic interface

PROPELLER
CONDENSER