

Bitzer 4EES-6Y-40S Condensing unit

Specifications

Marque	Bitzer
Le type	4EES-6Y-40S Condensing unit
Réfrigérant	Freon
kW at 0°C/+40°C	18,6
kW at -5°C/+40°C	15,4
kW at -10°C/+40°C	12,6
kW at -20°C/+40°C	8,1
kW at -30°C/+40°C	4,9
kW at -40°C/+40°C	2,7
kW at -45°C/+40°C	1,6
Contrôle de capacité	✓
Sur le châssis en acier	✓
Interrupteurs de sécurité de pression	✓
Réservoir de liquide	✓
Réservoir de liquide ltr.	40
Liquid déshydrateur ligne	✓
Voyant	✓
Electrovanne	✓
Panneau de configuration	✓
m3 / h	22,7 - 27,4
Remarques	Y.o.b. 2014
Condensing Unit	✓



(LxWxH)

Stoeltes

2320x1140x1160 mm



Description

Used Bitzer 4EES-6Y-40S Condensing unit

Used Bitzer condensing unit on Freon. Complete with 1 Bitzer 4EES-6Y-40S semi-hermetic reciprocating compressor, Guntner GCHC RD 050.2/1 condenser with an EBM-Papst S4E500-CM03-05 fan - 50/60 Hz - 0,68/0,88 kW - 1300/1400 RPM - diameter 500 mm, liquid receiver with a volume of 40 liter, liquid line filter drier, pressure and safety switches and a control cabinet.

*Why choose for HOSBV? We are not only the largest used refrigeration specialist in Europe, but also, we deliver all equipment including an extensive test, warranty, and industrial cleaning. *Optional we can also perform a new paint job and arrange the logistics.



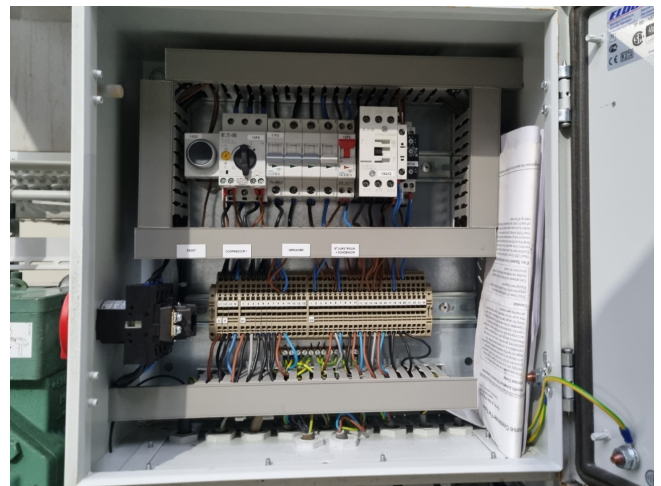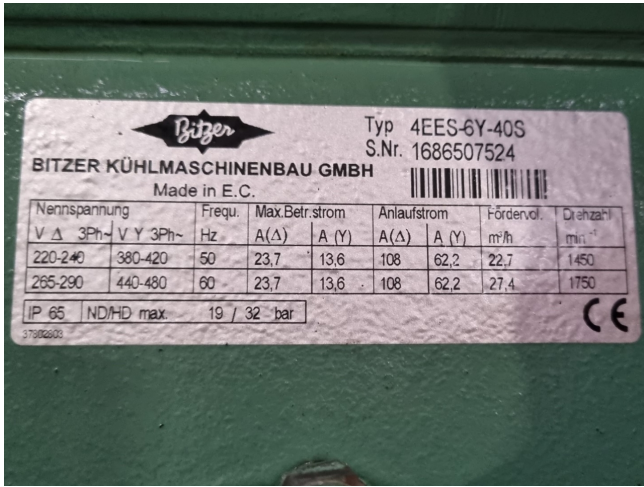



Güntner GmbH & Co. KG Hans-Güntner-Strasse 2-6 82256 Fürstenfeldbruck www.guenter.de		ERC	
Projektnummer - Project number	101125030		
Druckgerätebezeichnung - Pressure equipment type	GCHC RD 050.211-48-CH408RM		
UI Nummer - UI number	4240488		
Seriennummer - Serial number	50413584013.01910		
Herstellungsjahr - Year of manufacture	2020		
Ventilator/D/Drehzahl/Stromaufn. - Fan/D/Speed/Current	VT03087U / 2080 / 1300 min-1 / 3.1A		
Umgebungstemperatur - Ambient air temperature	-30 °C / +50 °C		
Volumen - Volume (V)	8.6 l		
Max. zulässiger Druck (PS)	32 / 0 bar	0 / 1 bar	
Max. permissible pressure (PS)			
Zulässige min./max. Temperatur (TS)	-80 °C / +100 °C	-60 °C / +60 °C	
Permissible min./max. temperature (TS)			
Prüfdruck (PT) / Prüfmedium	35.2 bar / Druckluft - Compressed air		
Test pressure (PT) / Test medium	2020-03-31		
Prüfdatum - Test date	2 / gaslöslig - gaseous		
Prüfdatum - Test date	Fluidgruppe / Zustand - Group of fluid / State		



Refrigeration Components	
Product:	Horizontal - gas receiver
Model:	R22-R124a-R104a-R101-R102
Volume (V)	8.6 l
Working Pressure (PS)	32 / 0 bar
Static / Pneumatic Pressure (PD)	32 / 0 bar
Working Temperature (TS)	-80 °C / +100 °C
Inlet / Outlet	1 / 2" 1 / 2" 1 / 2"
Equipment Weight	13.0 kg
Manufactured Year	03.03.2020
Category	417.81.01
Serial No.	0036